
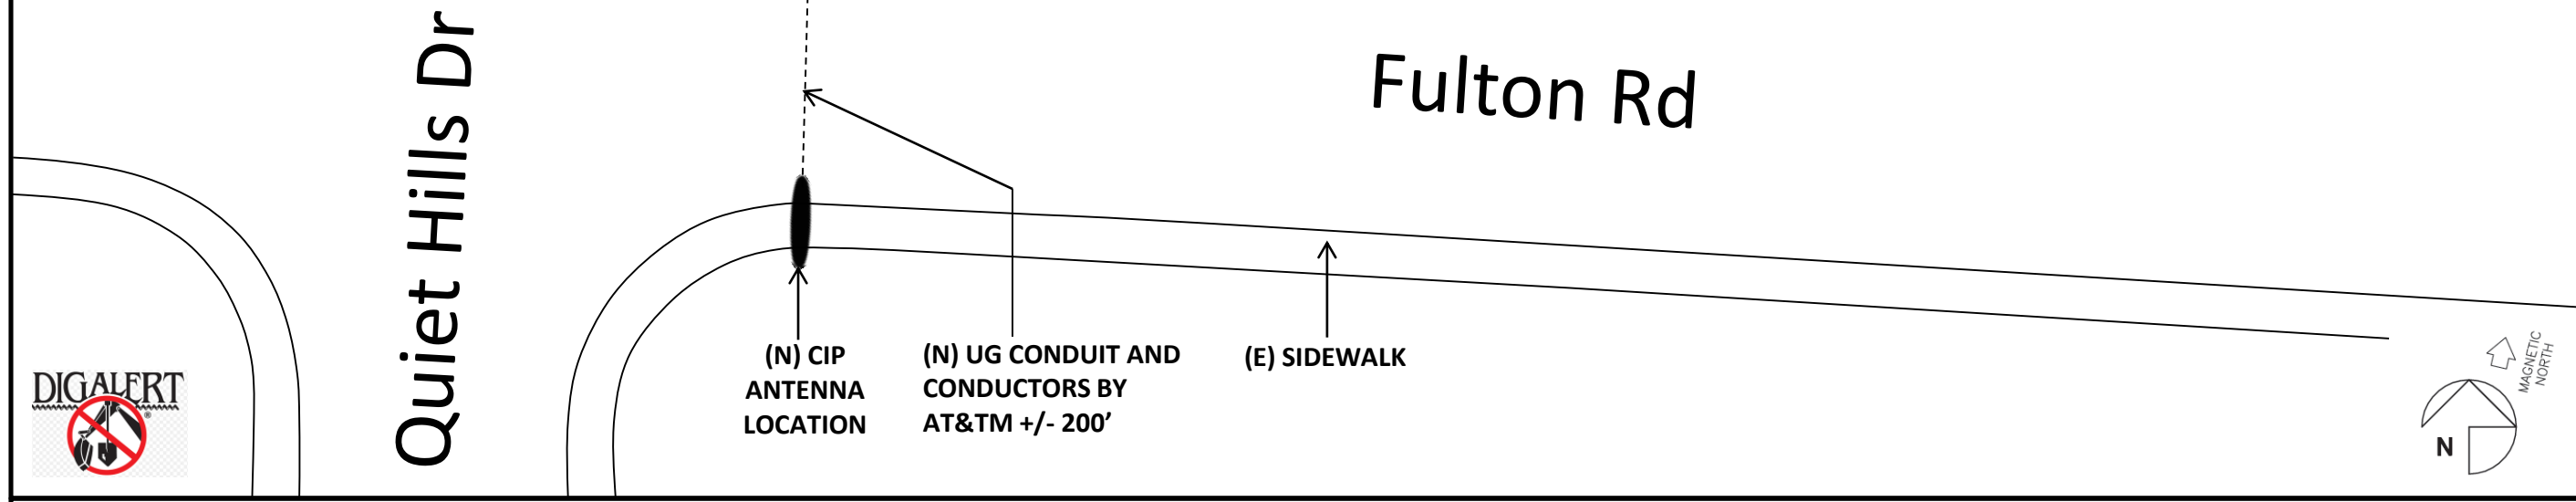



*** WTR/WTX TO BE INSTALLED A MINIMUM OF 5 FEET AWAY, MAXIMUM OF 10 FEET FROM SDG&E POWER SOURCE**

- (E) MOBILE HOME PARK
- (E) BLOCK WALL
- * (N) CIP WTR/WTX 2'X3' FUSE VAULT**
- (N) 5' TRENCH IN DIRT
W/ 2" SCHEDULE 40 PVC CONDUIT
- (E) UTILITY POLE #P123456
W/ Secondary = POC
- (N) SDG&E 3309 VAULT
- (N) 5' TRENCH IN DIRT
W/ 2" SCHEDULE 40 PVC CONDUIT
- (E) LANDSCAPE
- (E) CURB



POWER SITE PLAN

Company Logo	XYZ Telecom Services 999-999-9999	SITE NAME CALxxxxx_Rxx	SITE ADDRESS 1234 "1/3" Fulton Rd San Marcos, CA 92069 TB: 1109-C6	NO	DWG DATE	E-1
				1	08/28/2019	

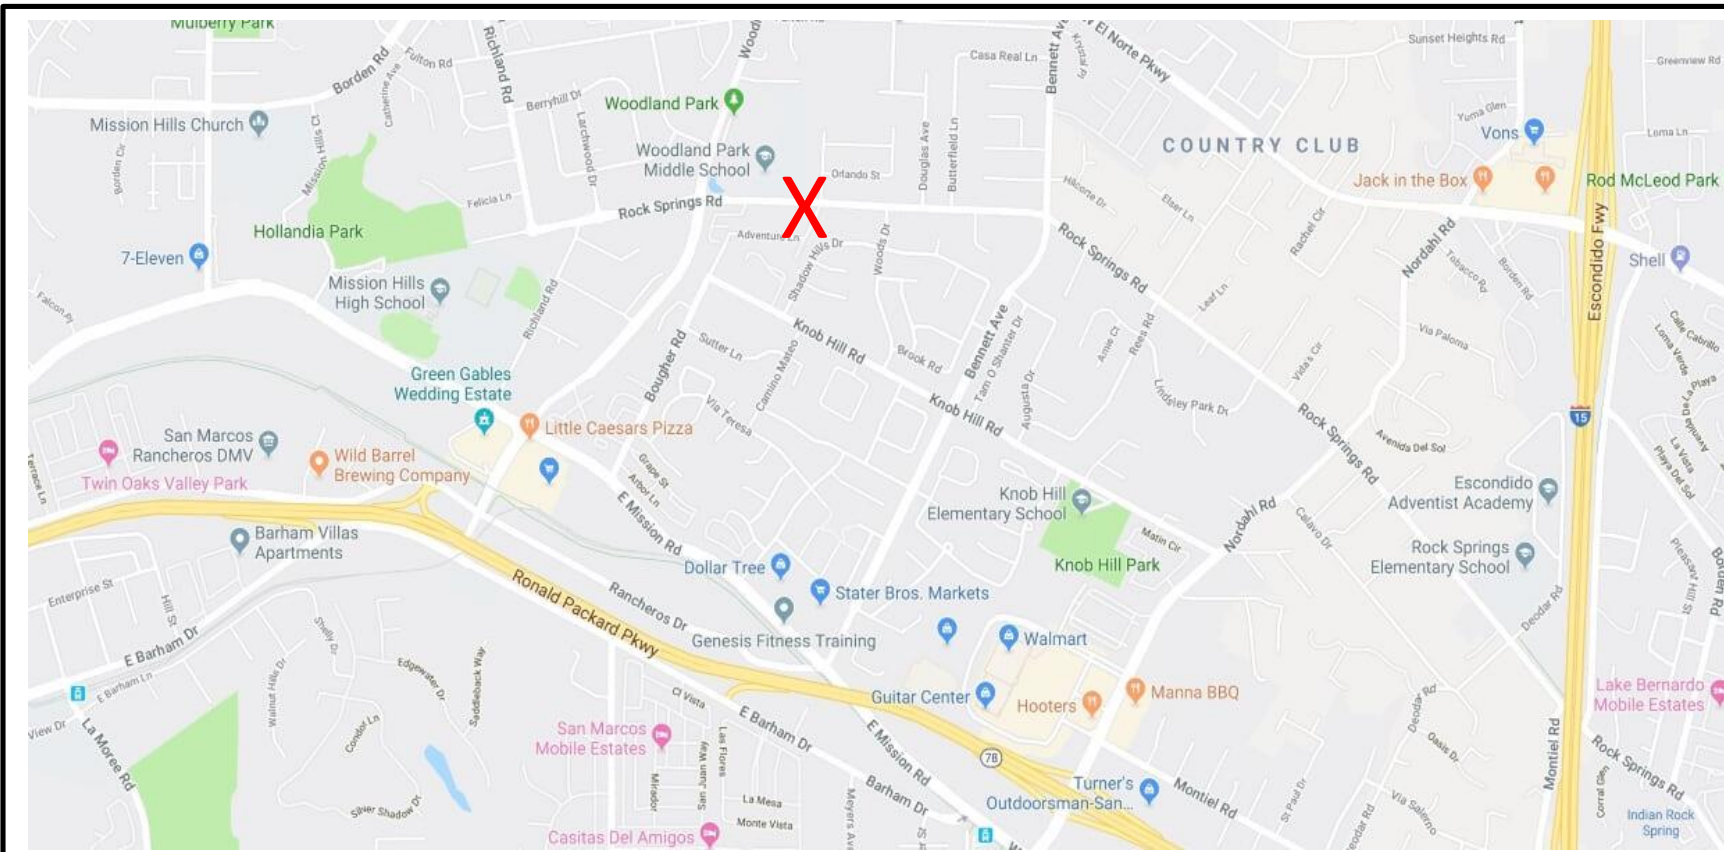

PROPOSED VAULT
LOCATION
TB:1109-C6

SITE LOCATION

Company Logo	XYZ Telecom Services 999-999-9999	SITE NAME CALxxxx_Rxx	SITE ADDRESS 1406 "1/3" Fulton Rd San Marcos, CA 92069 TB: 1109-C6	NO	DWG DATE	E-2
				1	08/28/2019	