

APPENDIX 1-D
EXISTING POWER LINE MAP FOR
SALT CREEK SUBSTATION PROPONENT'S
ENVIRONMENTAL ASSESSMENT (PEA)








Prepared by
AECOM
1420 Kettner Boulevard, Suite 500
San Diego, CA 92101

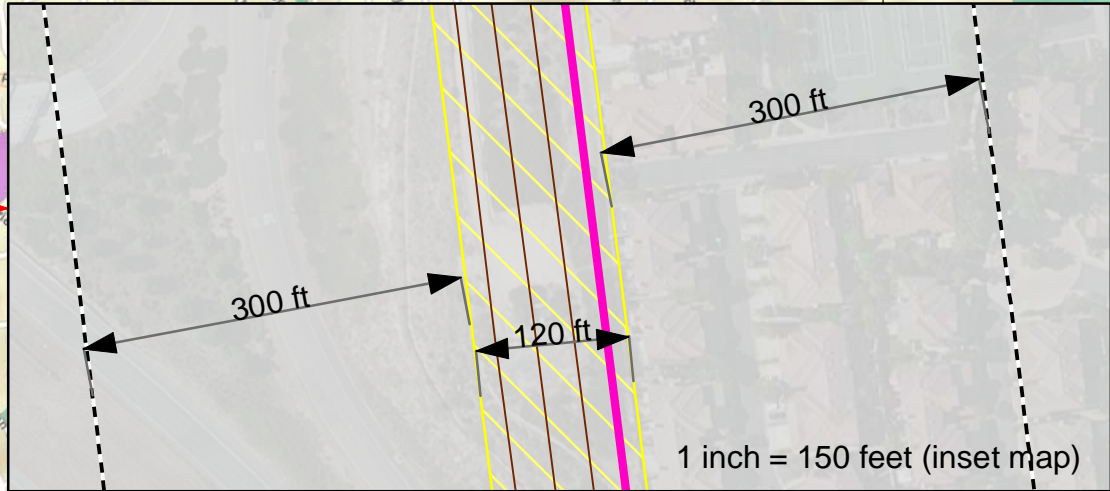
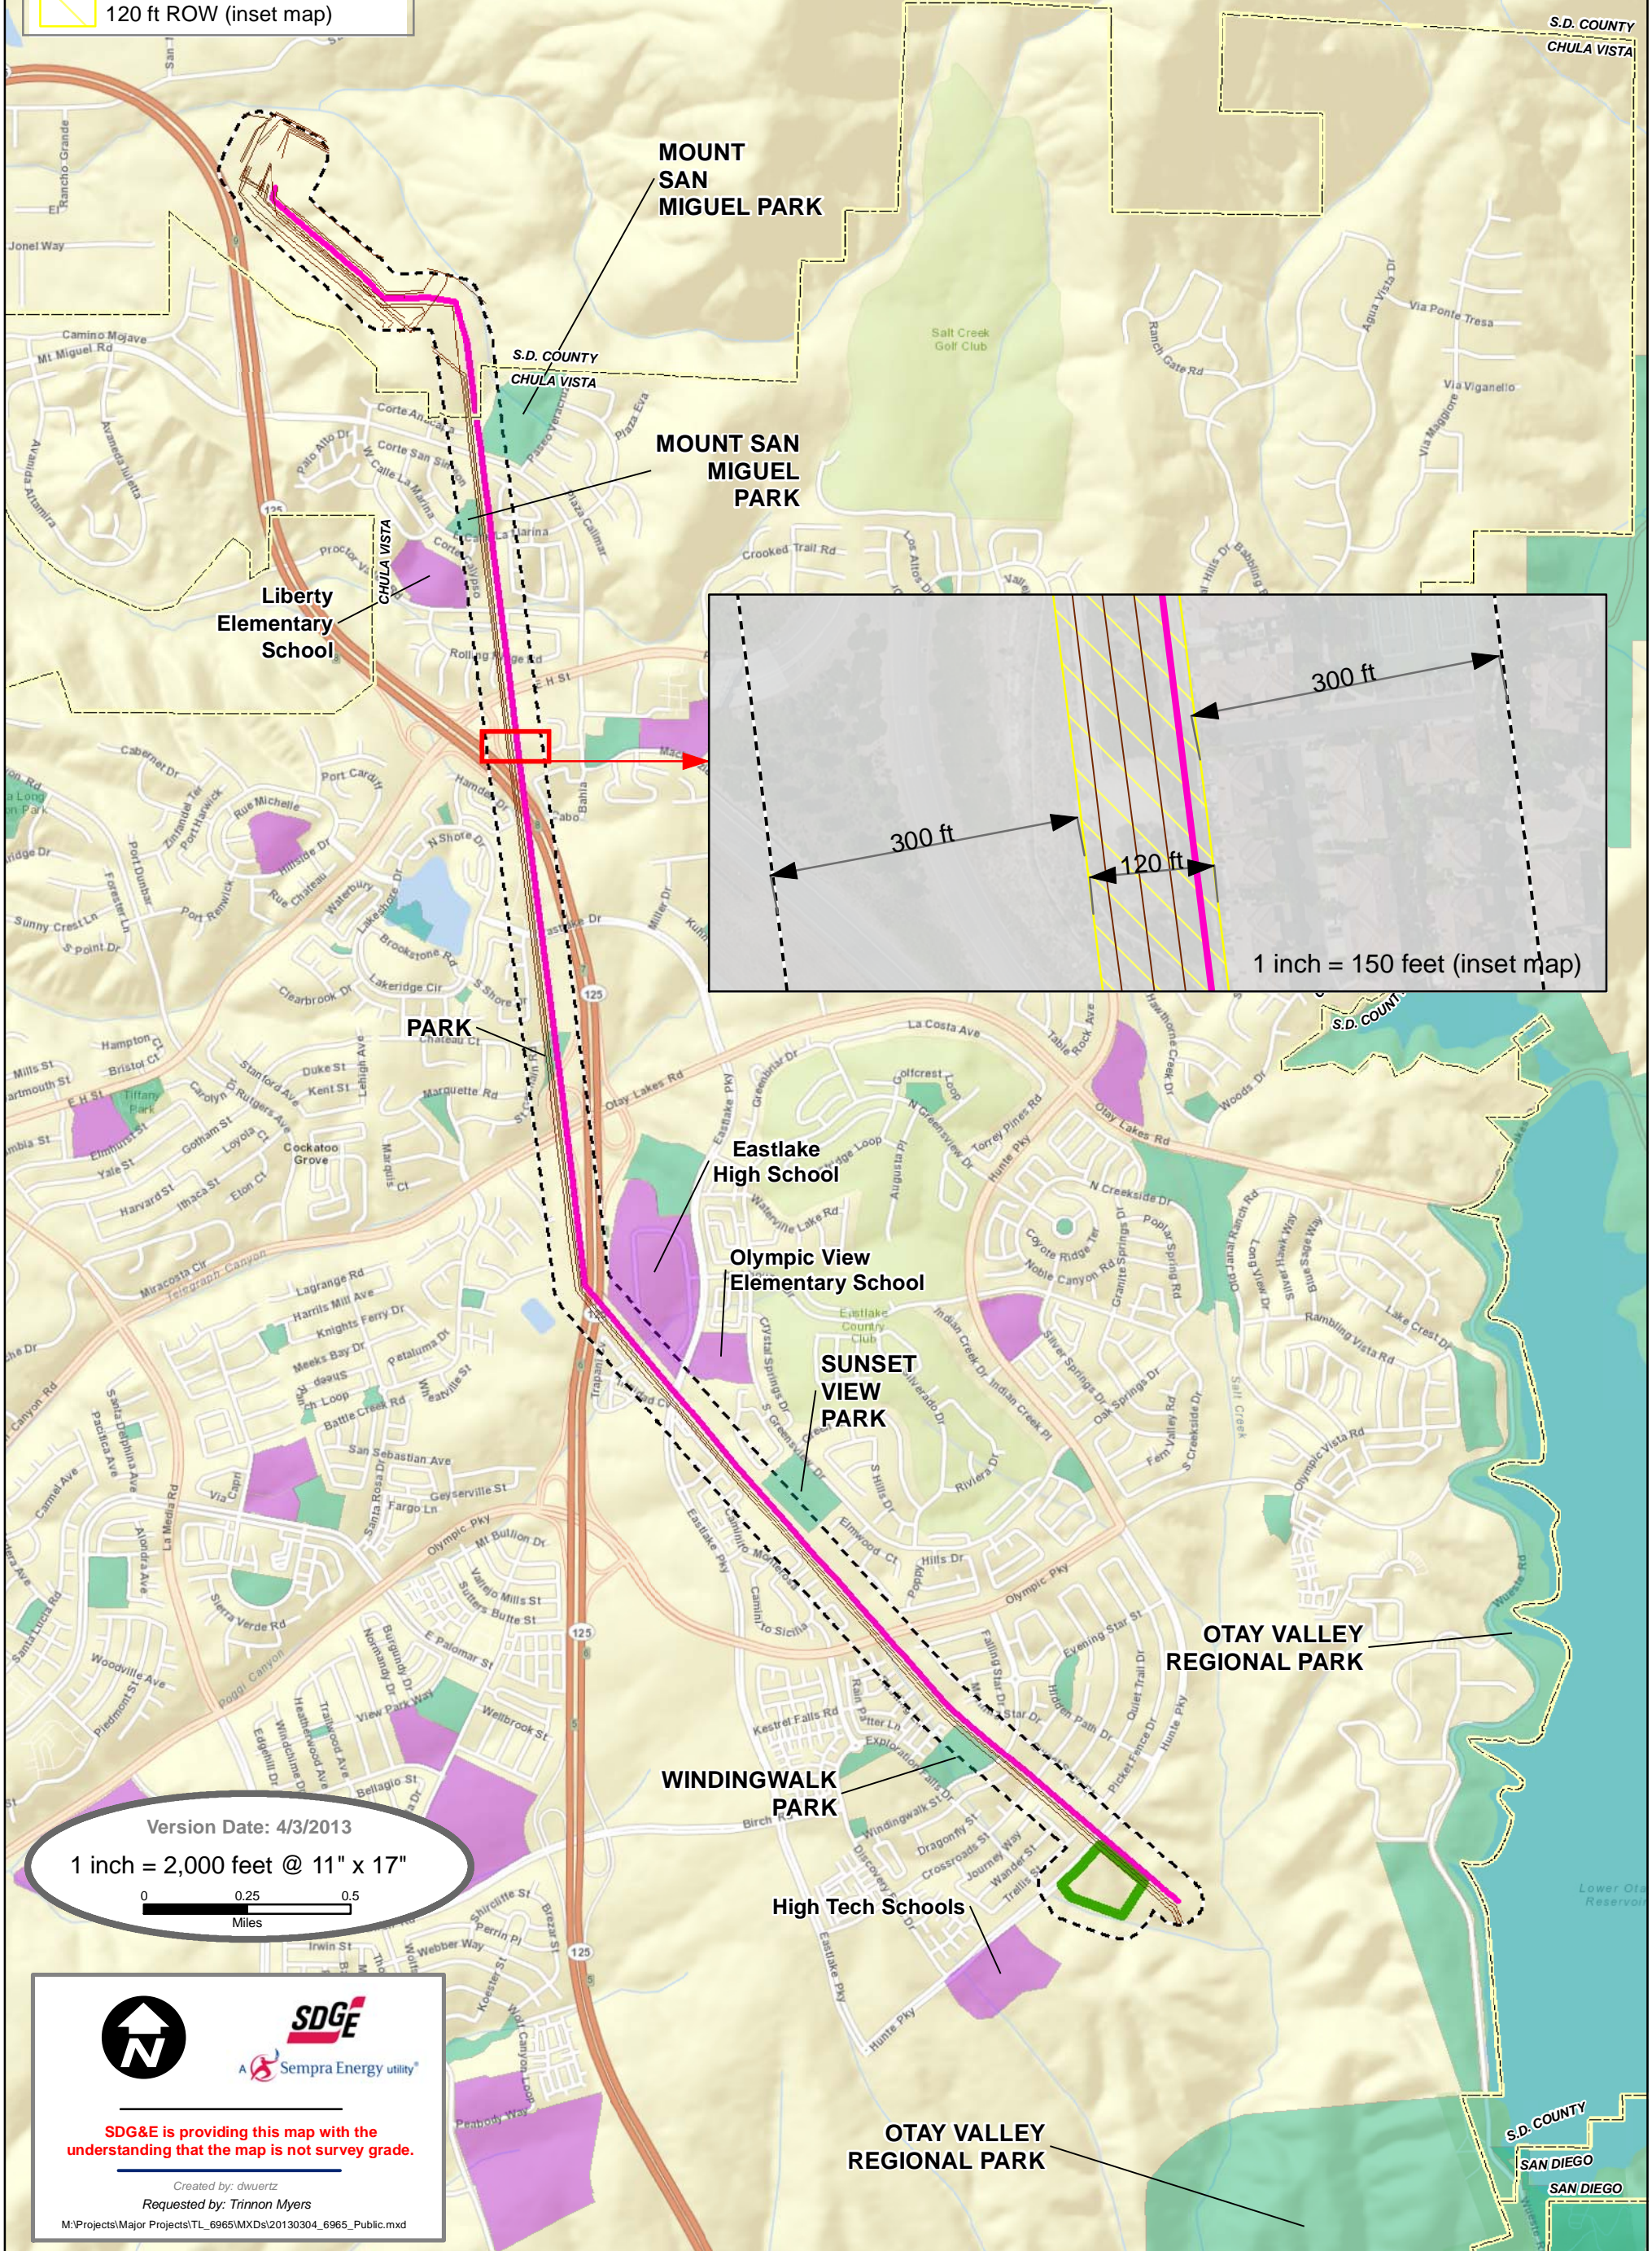
August 2013

Salt Creek Substation & Transmission Route



Existing Power Line Map

Legend

-  Proposed Transmission Route
-  Existing Transmission Line
-  Proposed Substation Site
-  300 ft Buffer
-  Park
-  School
-  120 ft ROW (inset map)



Version Date: 4/3/2013
 1 inch = 2,000 feet @ 11" x 17"

SDGE
 A Sempra Energy utility

SDG&E is providing this map with the understanding that the map is not survey grade.

Created by: dwuertz
 Requested by: Trinnon Myers

M:\Projects\Major Projects\TL_6965\WMSDs\20130304_6965_Public.mxd

S.D. COUNTY
 SAN DIEGO
 SAN DIEGO

