



Clay Faber
Director – Regulatory Affairs
8330 Century Park Court
San Diego, CA 92123-1548

Tel: 858-654-3563
Fax: 858-654-1788
cfaber@semprautilities.com

November 10, 2020

Mr. Leslie Palmer
Director, Safety and Enforcement Division
California Public Utilities Commission
505 Van Ness Avenue
San Francisco, CA 94102

SUBJECT: SAN DIEGO GAS & ELECTRIC COMPANY (SDG&E) PUBLIC SAFETY POWER SHUTOFF REPORT

Dear Mr. Palmer:

In accordance with Ordering Paragraph (OP) 2 of Decision (D.) 12-04-024, Section II.A of CPUC Resolution ESRB-8, D.19-05-042, and D.20-05-051, SDG&E is submitting this report in response to the Public Safety Power Shutoff (PSPS) event that occurred in SDG&E's service territory on October 26–27, 2020. As noted in the reporting requirements, this report has been verified by an SDG&E officer in accordance with Rule 1.11 of the Commission's Rules of Practice and Procedure.

In accordance with D.19-05-042, this report has also been distributed to the service lists for the following CPUC Rulemaking (R.) Proceedings: R.18-10-007 and R.18-12-005.

If you have any questions regarding this report, please contact Elizabeth Beaver at 858-654-1787, or ebeaver@sdge.com.

Sincerely,

/s/ Clay Faber
Clay Faber
Director—Regulatory Affairs

Attachment

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

This report covers the Public Safety Power Shutoff (PSPS) event that occurred in SDG&E's service area from October 26 through October 27, 2020. SDG&E submits this report to the Director of Safety and Enforcement Division (SED) and the service lists for Rulemaking (R.) 18-12-005 and R.18-10-007. This report includes the information required by Decision (D.) 12-04-024, Section II.A of CPUC Resolution ESRB-8, D.19-05-042, and D.20-05-051.

The analysis and data provided in this report are based on the most current information available at the time and are subject to modification resulting from additional analyses and assessments completed following submission of the report.

- 1. An explanation of SDG&E's decision to de-energize, including an explanation of alternatives considered; mitigation measures used to decrease the risk of utility-caused wildfires in de-energized areas; a thorough and detailed description of the quantitative and qualitative factors SDG&E considered in calling, sustaining or curtailing the PSPS event, including information regarding why PSPS was a last resort option; and the specific conditions SDG&E determined must be present for the de-energization event to be concluded.**

Response:

Explanation of the Decision to De-Energize

The decision to initiate Public Safety Power Shutoffs (PSPS) was made at SDG&E's Emergency Operations Center (EOC). SDG&E's EOC was fully staffed in a remote environment by a cross-functional team of electric operations, safety, meteorology, engineering, customer service, external affairs, communications, and other personnel, as well as a designated Utility Incident Commander (UIC). SDG&E activated its EOC to provide coordinated response; ensure there was informed decision-making; coordinate as-needed logistic support; and manage notifications to all impacted stakeholders, including customers, state agencies, local jurisdictions, tribal governments, elected representatives, and public safety partners.

SDG&E's EOC was activated at midnight on Monday, October 26, in response to weather forecasts indicating strong winds and low humidity were possible in portions of SDG&E's service area starting in the early morning on October 26. Based on advanced forecasts, SDG&E anticipated the most severe winds and increased fire risk conditions in the northwest corner of its service area, including the communities of Fallbrook and San Clemente, as well as surrounding areas.

SDG&E weighs many inputs when making the decision to de-energize portions of its system, and leverages refined situational awareness data and input from its subject matter experts when considering the need for PSPS, though experience with the program has indicated it is not appropriate to use a prescriptive technique to determine when to use PSPS, as wildfire conditions are dynamic and not every situation is the same. When making the decision to de-energize, SDG&E considers the following factors:

- Weather conditions: SDG&E's Fire Potential Index (FPI) ratings, Red Flag Warnings, and the Santa Ana Wildfire Threat Index (SAWTI)
- Vegetation conditions and the Vegetation Risk Index
- Field observations and flying/falling debris

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

- Information from first responders
- Meteorological data, including 10-years of historical information from weather stations and, 99th and 95th percentile winds
- Expected duration of conditions
- Location of any existing fires
- Wildfire activity in other parts of the state affecting resource availability
- Information on temporary construction

SDG&E has not developed a specific PSPS algorithm that lists, quantifies and calculates the weight of each factor that is incorporated into a PSPS. SDG&E has developed and published information regarding the factors and weights that go into the determination of the fire environment severity which is included in the FPI and SAWTI sections of SDG&E's 2020 Wildfire Mitigation Plan (WMP).

In addition to local weather conditions, SDG&E closely monitored and took into consideration wildfire activity throughout the state and the availability of fire suppression resources to the region. SDG&E's EOC remained activated through the duration of the Red Flag Warning (RFW) issued by the National Weather Service (NWS), which expired at 6 p.m. on Tuesday, October 27. During this event, the decision to implement PSPS was not based on a single factor, but rather a confluence of conditions. The central considerations in determining if PSPS were warranted are detailed below:

Weather Forecasts and Conditions

Summary: This was a particularly challenging weather event for the SDG&E service territory, both in terms of the forecast itself and the real-time evolution of weather and fuels conditions. In brief, strong low pressure moving into Southern California from the north-northeast brought areas of wetting rains, followed immediately by gusty north-northeast winds and low humidity. Initially, winds were confined to the extreme northwest portion of the SDG&E service area, with very strong winds measured just beyond the boundaries of the service area. Breezy conditions then expanded and spread across the remainder of the service territory as the event progressed, with an isolated pocket of much stronger winds on October 27. In areas that saw very little rainfall, fuels dried out quickly and were receptive to ignition shortly after the onset of gusty winds. In other areas, fuels did not fully dry out until after the strongest winds subsided.

The Weather Forecast: Weather forecasts in the days leading up to the PSPS event indicated areas of measurable rain, followed by locally gusty north-northeast winds and very low humidity. Wind gusts were forecast to exceed 55 mph in the extreme northwest corner of the SDG&E service area. A High Wind Warning and RFW were subsequently issued by the NWS for the extreme northwest portion of the SDG&E service area, where there was high confidence of strong winds and dry fuels. The Fire Potential Index (FPI) was forecast to be Extreme in the far northwest portion of the service area and Elevated in all other areas. In San Diego County, there was considerable uncertainty regarding the wind forecast, the rainfall forecast, and subsequent drying of fuels. The consensus among forecasters was strong winds were unlikely to materialize in San Diego County and dead fuels were not expected to fully dry out until after winds had subsided. Wind gusts in eastern San Diego County were forecast to remain below 40 mph.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

While the consensus forecast was correct in many respects, a pocket of much stronger than forecast wind developed suddenly in the areas of Crestwood and Boulevard shortly after 8:30 a.m. on October 27, prompting quick action by SDG&E. These unexpected strong winds were in areas that saw very little rainfall in the previous days.

Weather conditions on October 26, 2020: The strongest winds and driest conditions were initially confined to the far northwest corner of the service territory in the Camp Pendleton and De Luz areas. The De Luz area does not typically experience stronger Santa Ana winds, but on October 26, wind gusts at the De Luz weather station were in the top 1% of all Santa Ana wind gusts measured at that location, and only 4 mph below the station record. Just west of De Luz, the Buffalo Bump weather station measured wind gusts up to 55 mph, indicating much stronger winds aloft. These areas saw very little rainfall the day before and humidity values on October 26 were in the single digits and teens. Breezy conditions were present across the remainder of the service territory later in the day, but wind gusts were either well below what is typical for a Santa Ana or were occurring in areas where fuels were still somewhat wet.

Weather conditions on October 27, 2020: The morning of October 27 began with only locally breezy conditions, as forecast. However, a pocket of stronger winds very suddenly developed in the far southeast corner of San Diego County shortly after 8:30 a.m. Near the community of Live Oak Springs, wind gusts peaked at 63 mph at the Crestwood weather station. Recorded wind speeds at the Crestwood weather station on October 27 were in the top five strongest Santa Ana wind gusts measured at that location, and in the top 1% of all Santa Ana winds measured at that location. Recorded wind speeds significantly exceeded the forecast for this area. Nearby, wind gusts were measured near 50 mph at La Posta, White Star, and Boulevard. Outside of these areas, gusts were somewhat unremarkable. Rainfall in the areas with the strongest winds was light, relative to other areas, with only a couple hundredths of an inch (< 0.05”) of precipitation, and after a full day of drying, fuels were very receptive to ignition.

Local Fire Conditions and Fire Potential

SDG&E monitored fire activity, as well as staffing levels of local, state, and federal fire agencies locally and regionally throughout this weather event. This information is part of the larger situational awareness picture and aids in the decision of whether or not PSPS is warranted. This is achieved by communicating with agencies that have jurisdiction in the SDG&E service area and monitoring multiple incident notification tools on a 24/7 basis.

Alternatives Considered

Once extreme fire risk weather conditions have materialized, alternatives to PSPS are limited. SDG&E has dedicated substantial resources to wildfire prevention and mitigation activities for more than a decade, including work to enhance the resiliency of its grid and to add tools and technologies for weather monitoring and wildfire mitigation.¹ In addition to

¹ See SDG&E’s 2020 Wildfire Mitigation Plan for additional information on SDG&E’s ongoing wildfire prevention and mitigation work:
<https://www.sdge.com/sites/default/files/regulatory/SDG%26E%202020%20Wildfire%20Mitigation%20Plan%20Revised%2003-02-2020.pdf>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

improving SDG&E's ability to forecast and monitor extreme weather conditions, these efforts enable SDG&E to reduce the number of PSPS events and mitigate the scope of events when PSPS is implemented.

In the days leading up to potential PSPS events, including this event, SDG&E's meteorologists closely monitor weather forecasts to identify the specific areas most likely to experience weather conditions that warrant PSPS. Operational groups use these targeted forecasts to strategically stage field crews and observers in areas anticipated to experience the most severe weather.

Once fire weather conditions materialize, stations in SDG&E's weather network provide reading of conditions including wind speeds, temperatures and relative humidity every 30 seconds. This data is monitored in real time by staff at SDG&E's EOC and used to determine if PSPS should be implemented. This close monitoring and frequent updating of location-specific data enables SDG&E to implement PSPS only as a last resort when conditions warrant de-energization.

Mitigation Measures to Decrease Utility-Caused Fire Risk in De-Energized Areas

SDG&E implements mitigation measures used to decrease the risk of utility caused wildfires by reinforcing the standards listed in SDG&E Electric Standard Practice 113.1—Operations and Maintenance Wildland Fire Prevention Plan and increasing use of prevention resources. All SDG&E field personnel are required to receive annual training on fire prevention. All non-emergency work is restricted in areas where there is extreme fire potential.

During this event, SDG&E strategically placed observers and field crews at or near the location of the facilities forecast to experience the most severe weather conditions. By staging personnel at these locations, SDG&E is able to quickly react to changes in conditions and ensure energized lines are operated safely with no imminent threats to their integrity, and that de-energized lines are inspected for safety prior to re-energization.

Conditions to Conclude the PSPS Event

Similar to the decision to initiate a PSPS event, the decision to conclude a PSPS event is made based on a number of factors.

During this event, SDG&E Meteorologists utilized real time weather station data and forecast models to determine the Santa Ana winds has peaked and were trending weaker, without any indication of potential resurgence of conditions that could necessitate additional PSPS.

Based on favorable weather conditions, SDG&E's UIC approved patrols of the de-energized lines. Once patrols were completed and confirmed there was no damage to the infrastructure, the UIC approved re-energization of the devices.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

2. All factors considered by SDG&E in its decision to de-energize, including wind speed, temperature, humidity and vegetation moisture in the vicinity of the de-energized circuits.

Response:

The decision to de-energize for public safety is not based on a single factor; numerous criteria are considered when making this decision. Key bases for these decisions included, but were not limited to:

- The RFW issued by the NWS indicated that the combination of strong winds and critically low relative humidity would result in critical fire weather conditions with the potential for extreme fire behavior;
- The potential for wind gusts in excess of 55 mph in higher terrain areas of the northwest portion of SDG&E's service area;
- The potential impact to customers with access and functional needs, including Medical Baseline (MBL) customers on each de-energized circuit, recognizing PSPS events can result in significant impacts to these customers;
- SDG&E's Fire Potential Index (FPI) was Extreme for Orange County and Elevated in all other districts, indicating the potential for large fires, should an ignition occur;
- Infrastructure in temporary configurations due to construction activities;
- Observer reports of imminent threats to power lines, including tree branches encroaching overhead lines, wire movement, debris blown into lines;
- Fire-suppression resources were potentially unavailable due to high winds and time of day, should an ignition occur;
- Wildfire activity across the state, including the Silverado and Blue Ridge Fires in Orange County;
- Accessibility could be constrained should an ignition occur;
- The outages could be targeted to minimize impacts to customers; and
- A review of active outages on SDG&E's system.

On October 26, the strongest winds and driest conditions were confined to the far northwest corner of the SDG&E service area in Camp Pendleton and De Luz. The De Luz area does not typically experience stronger Santa Ana winds, but on October 26, wind gusts at the De Luz weather station were in the top 1% of all Santa Ana wind gusts measured at that location and only 4 mph off the station record. Just west of De Luz, the Buffalo Bump weather station measured wind gusts up to 55 mph, indicating much stronger winds aloft. These areas saw very little rainfall the day before and humidity on October 26 was in the single digits and teens. Breezy conditions overspread the remainder of the service territory later in the day, but wind gusts were either well below what is typical for a Santa Ana or were occurring in areas where fuels were still somewhat wet.


On Oct. 27, in addition to the factors considered above, the below information was considered when implementing unanticipated PSPS in portions of southeastern San Diego County:

- **Rainfall:** The map below shows rainfall totals measured across the San Diego area in the 24–36 hours preceding the peak of the winds across the region. As shown in the map below, rainfall totals across the far southeastern portions of the territory in the vicinity of

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

the PSPS were less than 0.05". This precipitation occurred more than 24 hours prior to peak winds and was not sufficient to decrease the wildfire potential or prevent a dangerous rate of spread should a wildfire ignition occurred.


San Diego Area Rainfall Totals: October 24–25

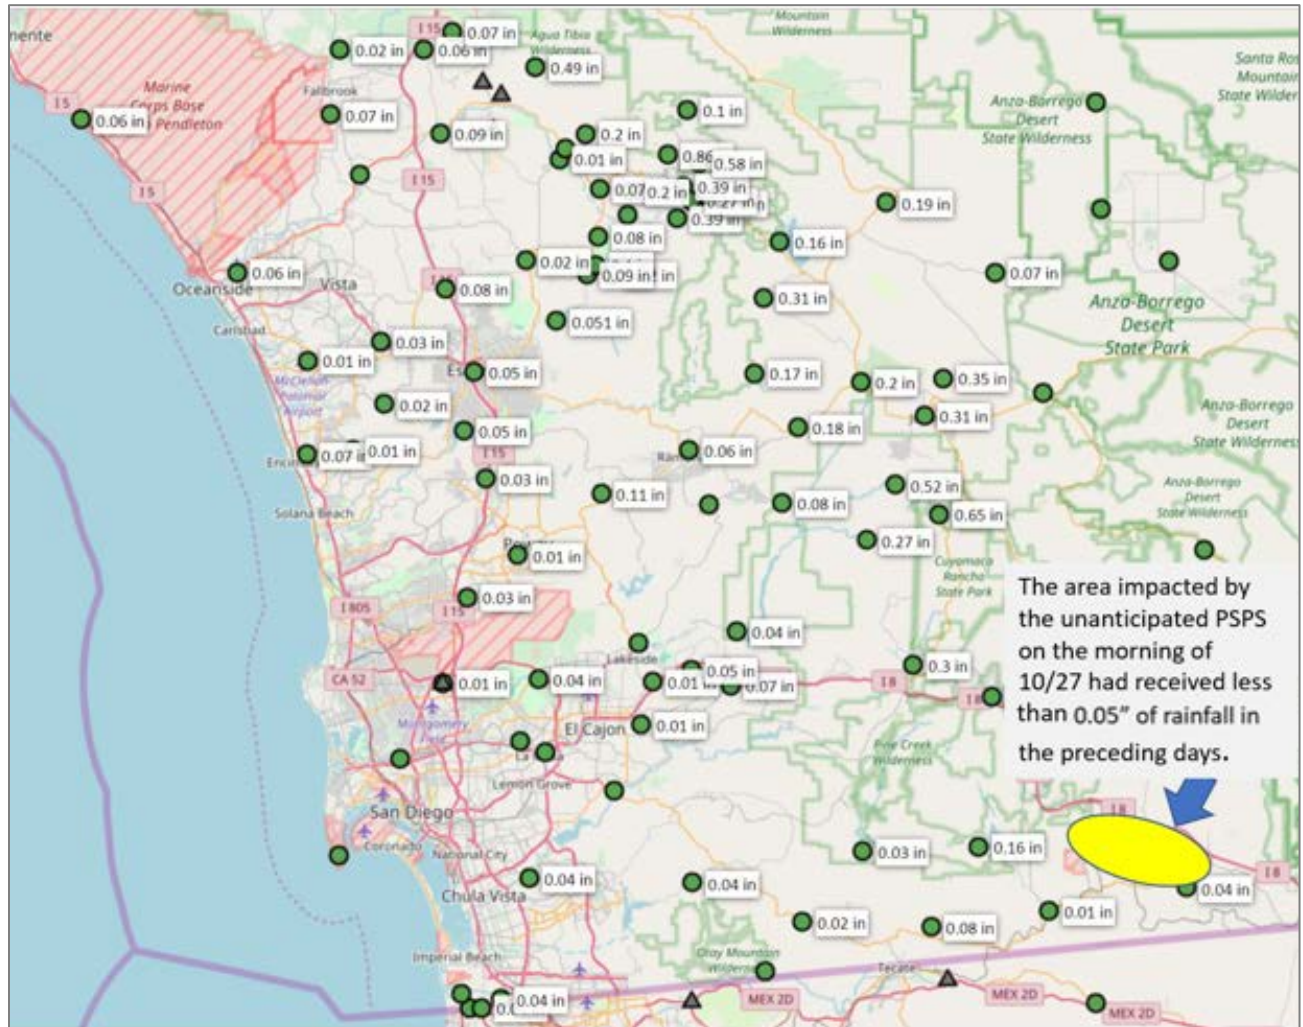

- **Fuel Moisture:** In addition to rainfall in the area, SDG&E closely tracked fuel moisture measurements from Remote Automated Weather Stations in the area to determine the criticality of the dead fuel moisture. The fuel moisture reading that was most representative for this region was from the Mountain Springs Grade Weather Station, which was reporting only 5 grams of moisture, which is extreme dry and can support a dangerous rate of wildfire spread, should an ignition occur. The map below highlights the area impacted by the unanticipated PSPS and the 10-hour dead fuel moistures:

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

San Diego County Dead Fuel Moistures, October 26–27, 2020

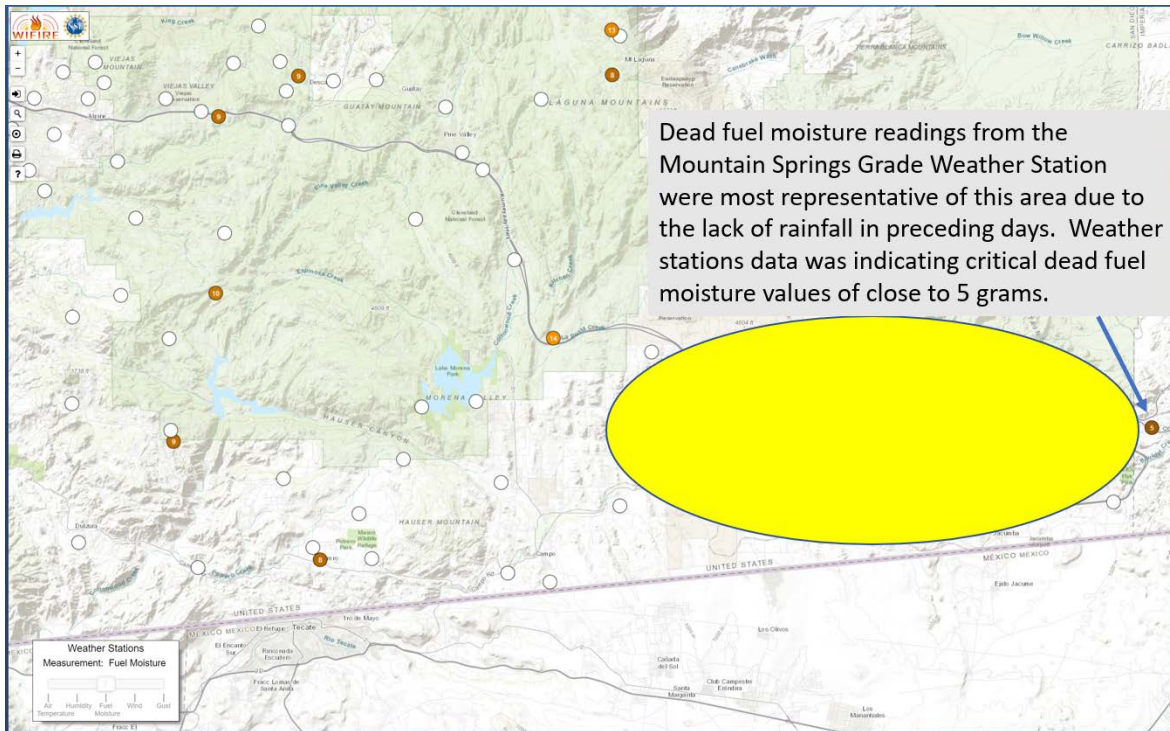

As the strong low-pressure system was exiting the region on the morning of October 27, winds trended as forecast across the San Diego County Mountains, which led SDG&E’s meteorology team to believe that the far southeastern portions of the county would also trend as forecast. That said, winds began trending significantly above normal across the far southeastern corner of the service territory, with peak gusts in the top 1% of all Santa Ana Winds SDG&E has measured in that area over the last decade.

The combination of the extreme winds, a lack of significant rainfall, and very dry dead fuel moisture readings were taken into consideration, along with the factors described above, to ultimately implement the PSPS for this area.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

3. An explanation of how the utility determined that the benefit of de-energization outweighed potential public safety risks.

Response:

Advanced weather forecasts indicated that communities in the northwest portion of SDG&E's service area would experience strong winds and low levels of humidity starting in the morning on Monday, October 26. These areas do not typically experience stronger Santa Ana winds. SDG&E was concerned the forecast conditions posed an increased risk of wildfire ignition, and that an ignition would likely result in large, destructive wildfires, with rapid rates of spread and long-range spotting. These concerns were bolstered by the issuance of the RFW by the NWS, which was in effect for the region from 2 a.m. Monday, October 26 to 6 p.m. Tuesday, October 27. During the period of anticipated severe weather, SDG&E monitored real time weather data, observations of vegetation moisture levels, and weather conditions.

Additionally, SDG&E took into consideration the Blue Ridge and Silverado Fires in Orange County, just to the north of its service territory, as well as other active fires occurring under similar conditions throughout the state. These large, destructive fires validated the severity of the fire weather conditions. SDG&E determined the conditions warranted de-energizing certain facilities which might otherwise provide a source of ignition.

SDG&E does not make the decision to de-energize lightly. Based on the best available information, SDG&E applies its judgment and experience to the situation at hand, with the safety of the communities and customers it serves, as well as its workforce, as the top priority in the decision-making process.

While weather conditions warranted implementation of PSPS to reduce the potential for an ignition, SDG&E was also mindful of the impact PSPS events have on customers, and particularly those with access and functional needs (AFN). Loss of electricity can have a range of consequences for customers, including medical risks, stress and anxiety, and economic losses. Prior to the 2020 wildfire season, SDG&E launched new partnership models with 2-1-1 San Diego and 2-1-1 Orange County to support customers with AFN during PSPS events. Through these partnerships, customers can receive services such as assisted transportation, hotel vouchers, and food resiliency, among others. Additionally, 2-1-1 San Diego and 2-1-1 Orange County amplify PSPS notifications and messaging to more broadly reach the AFN community.

SDG&E also worked to reduce the hardships customers experience during PSPS events through its Generator Grant Program. SDG&E offered portable backup battery units (e.g. Goal Zero Yeti 3000) to MBL customers impacted by PSPS events in 2019. As of October 2020, more than 1,400 customers have received backup batteries from SDG&E, including approximately 75 MBL customers living in mobile home parks within the HFTD.

Based on the anticipated scope and duration of this PSPS event, and the likelihood of long-term, devastating public safety impacts should a large wildfire occur, SDG&E determined de-energization was the appropriate measure to ensure public safety.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

4. The time, place and duration of the event and whether the areas affected by the de-energization are classified as Zone 1, Tier 2, or Tier 3 per the definition in General Order 95, Rule 21.2-D. If service is not restored within 24-hours of the termination of the PSPS event, SDG&E must explain why it was not able to timely restore service.

Response:

Circuit/ Device	Communities	Start Date/Time	Restoration Date/Time	Duration (HH:MM)	GO 95 Rule 21.2D Classification
239-15R	Fallbrook	10/26/2020 8:48 a.m.	10/26/2020 4:06 p.m.	07:18	Tier 3
1234	Fallbrook	10/26/2020 8:51 a.m.	10/26/2020 4:40 p.m.	07:49	Tier 2
520-35R	Fallbrook	10/26/2020 8:59 a.m.	10/26/2020 4:51 p.m.	07:52	Tier 2
520-18R	Fallbrook	10/26/2020 09:21 a.m.	10/26/2020 4:16 p.m.	06:55	Tier 2
520-26R	Fallbrook	10/26/2020 10:50 a.m.	10/26/2020 4:26 p.m.	05:36	Tier 2
1215-12R	Boulevard, La Posta Reservation, Campo Reservation, Manzanita Reservation	10/27/2020 9:12 a.m.	10/27/2020 5:19 p.m.	08:07	Tier 3
445-39R	Boulevard, Campo Reservation	10/27/2020 9:48 a.m.	10/27/2020 4:24 p.m.	06:36	Tier 2
444-43R	Jacumba	10/27/2020 10:39 a.m.	10/27/2020 4:07 p.m.	05:28	Tier 2

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

5. Describe how sectionalization was considered/implemented and the extent to which it impacted the size and scope of the de-energization event.

Response:

SDG&E utilized sectionalization during this PSPS event to reduce customer impacts. Leveraging real-time data from the SDG&E weather network in the area of the severe weather, SDG&E was able to confirm the strong winds were isolated to portions of the majority of impacted circuits. As a result, SDG&E de-energized only portions of five of the six circuits impacted during this event, as opposed to the entire circuits. By de-energizing only portions of the circuits, SDG&E was able to avert PSPS impacts for approximately 3,178 customer accounts.

Circuit	De-energized device(s)	Total # meters on circuit	# Meters not de-energized due to sectionalization
239	239-15R	1,332	845
520	520-35R, 520-18R, 520-26R	3,024	2,156
1215	1215-12R	253	11
445	445-39R	963	162
444	444-43R	427	4

Additionally, in an effort to limit the number of customers potentially in scope for this event, where possible, SDG&E performed offloading of customers on circuits in certain areas forecast to experience the most severe fire risk conditions. In total, SDG&E rerouted service to other circuits for approximately 5,692 customer accounts that are normally served by circuits that were being monitored for potential PSPS outages during this weather event. While weather conditions did not ultimately necessitate PSPS of these circuits, SDG&E was prepared to implement shutoffs minimizing the number of customers impacted, had PSPS been warranted.


SDG&E also used sectionalizing devices to send warning messages and notifications of potential PSPS impacts to specific, more precise customer groups.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

6. The number of affected customers, broken down by residential, medical baseline, commercial/industrial and other.

Response:

Circuit/ Device	Total # Impacted Customer Meters	Residential Meters	Commercial/ Industrial Meters	Medical Baseline Accounts	Self- identified vulnerable ²	PSPS Critical Facility Meters
239-15R	486	296	190	16	22	16
1234	1,553	1,415	138	65	56	32
520-35R	373	233	140	11	11	2
520-18R	330	136	194	4	9	7
520-26R	165	145	20	10	4	3
1215-12R	242	152	90	12	16	53
445-39R	801	640	161	55	58	31
444-43R	423	338	85	38	31	30
Total	4,373	3,355	1,018	211	213³	174

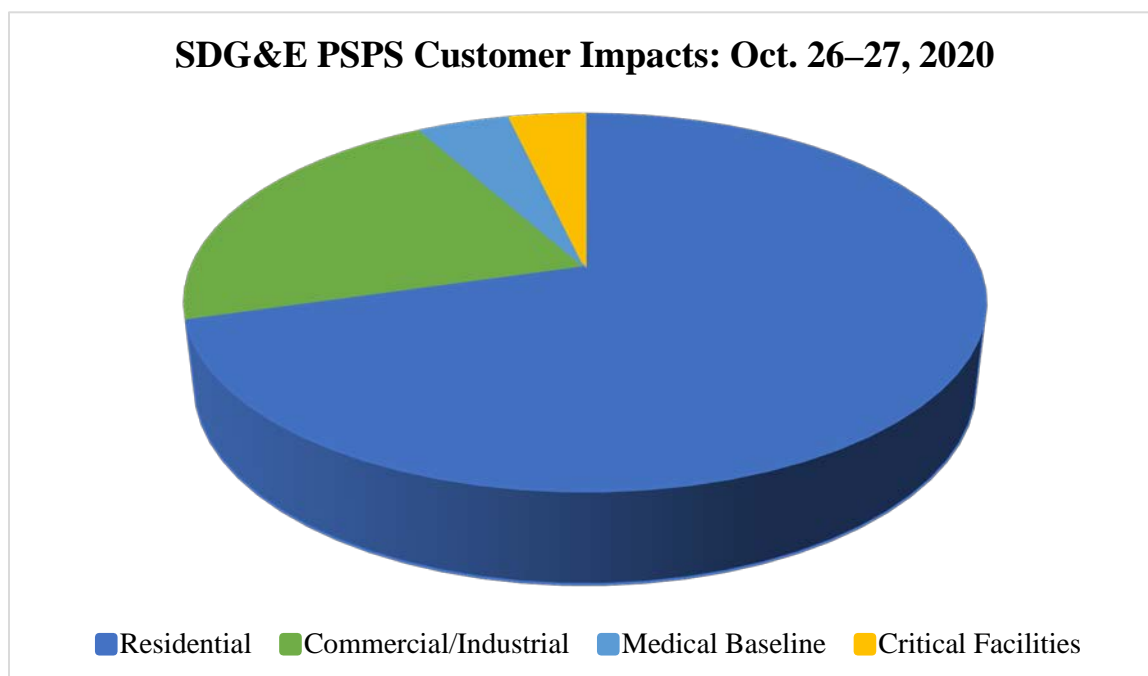

² Includes customers who have self-identified as: disabled or over 62-years-old/elderly, and customers who receive an alternate form of bill (e.g. braille).

³ Totals do not represent unique customer counts. Customers who have self-identified as vulnerable may also be registered as MBL customers.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

- 7. Describe any wind-related damage to SDG&E’s overhead powerline facilities in the areas where power was shutoff.**

Response:

No weather-related damage to SDG&E facilities was reported in the areas impacted by PSPS during this event.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

- 8. Provide a description of the customer notice and any other mitigation provided by SDG&E. Include a copy of all notifications, the timing of notifications, the methods of notifications and who (IOU or public safety partner) made the notification. If SDG&E failed to provide notifications according to the timelines set forth in the CPUC PSPS Guidelines (see D.19-05-042), include an explanation of the circumstances that resulted in such failure. Include the number of false communications made and an explanation for any false communications by citing the sources of changing data.**

Response:

Starting on October 24, SDG&E notified customers in areas that would potentially be impacted by PSPS on October 26. Notifications were made via outbound dialer, email and personal phone calls. SDG&E also shared information with the public through its websites (SDGEnews.com and SDGE.com), SDG&E social media channels (Twitter, Facebook, Instagram), and with local, state and national news media outlets.

Due to a clerical error, SDG&E did not provide notification to three MBL customers prior to de-energization on October 26. SDG&E completed in-person notifications for these three customers on October 26 after PSPS started. Affirmative notifications were made by SDG&E to 97% of MBL customers during this event. The clerical error that resulted in the missed notifications has since been corrected.

SDG&E was not able to provide advanced notifications to customers impacted by PSPS on October 27, as weather forecasts did not indicate conditions potentially warranting PSPS in the impacted areas. As noted in responses to items 1 and 2 of this report, fire weather conditions on October 27 were unexpected and arrived suddenly in areas of southeast San Diego. Once conditions materialized that warranted the use of PSPS, SDG&E began notifying impacted customers.

The first PSPS outage on October 27 began at 9:12 a.m. By 9:21 a.m., SDG&E started making direct notifications to impacted customers and shared information via digital channels, including SDGE.com and social media. SDG&E made notifications to customers throughout the event on October 27 to provide updates related to patrols and restoration of service.

Approximately 1,466 customers, including 1,130 residential, 105 MBL, and 336 commercial/industrial, impacted by PSPS on Oct. 27 did not receive notifications at the 24–48-hour prior benchmark, or at the 1–4-hour prior benchmark.

SDG&E has also taken additional measures to mitigate impacts to customers with AFN, including MBL customers. In preparation for the 2020 wildfire season, SDG&E launched new partnership models with 2-1-1 San Diego and 2-1-1 Orange County to support customers with AFN during PSPS. Through these support models, customers with AFN can receive services such as assisted transportation, hotel vouchers, and food resiliency, among others. 2-1-1 also further amplifies PSPS notifications to more broadly reach the AFN community.

As part of its Generator Grant Program, SDG&E offered portable backup battery units (e.g., Goal Zero Yeti 3000) to MBL customers who were impacted by PSPS in 2019. As of October 2020, SDG&E has provided more than 1,400 backup batteries, including ~75 specifically targeted to MBL customers in Mobile Home Parks who reside in the HFTD.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

See Appendix 1 for detailed information regarding customer notifications

See Appendix 2 for details of notifications to Public Safety and Community Partners

See Appendix 3 for details of notifications to the CPUC

See Appendix 4 for details of notifications to Government Officials/Representatives

See Appendix 5 for details of notifications to Cal OES

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

- 9. For those customers where positive or affirmative notification was attempted, an accounting of the customers (which tariff and/or access and functional needs population designation), the number of notification attempts made, the timing of attempts, who made the notification attempt (utility or public safety partner) and the number of customers for whom positive notification was achieved.**

Response:

All customer notifications were made by SDG&E. During this event, SDG&E successfully made affirmative notifications to medical baseline (MBL) customers who were not reached by phone. SDG&E completed 334 in-person notifications for customers during this event.

Please see Appendix 1 for detailed information regarding customer notifications.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

- 10. The address of each community assistance location during a de-energization event, describe the location (building, trailer, etc.), describe the assistance available at each location, and the days and hours it was open.**

Response:

SDG&E opened one Community Resource Center (CRC) during this event on October 26. SDG&E deployed one of its Mobile Command Trailers to the Fallbrook Branch Library to serve as a drive-through CRC. SDG&E used a Mobile Command Trailer to ensure visitors were able to maintain social distancing protocols to prevent transmission of COVID-19. The CRC was located near the Fallbrook Branch Library.

On October 27, SDG&E began preparing CRC resources once weather conditions warranting PSPS materialized in areas of eastern San Diego County. However, a CRC was not ultimately activated, as power was fully restored before all resources were mobilized. The same amenities offered in the table above would have been available at this location had it been needed

SDG&E CRC Details for PSPS Event: October 26–27, 2020

Location	Site description	Resources provided	Days/hours of operation
124 S Mission Rd. Fallbrook, CA 92028 Near the Fallbrook Branch Library	Drive-through CRC; SDG&E Mobile Command Trailer	Bottled water, light snacks, outage updates, medical device charging, ice, bulk water (via large water truck), and care packages containing: reusable water bag, hot/cold storage bag, duct tape, AM/FM hazard weather radio, solar light, solar power bank, toilet paper, personal safety kit, vehicle power inverter.	10/26/2020 8:45 a.m.– 5 p.m.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

11. A description and evaluation of engagement with local and state public safety partners and community partners in providing advanced outreach/notification during the PSPS event.

Response:


SDG&E works throughout the year leading up to wildfire season on education and outreach with its local and state public safety partners and community partners. In 2020, prior to the COVID Pandemic, education and outreach included in-person tours and trainings, and continued with virtual tours, webinars and trainings during the COVID Pandemic.

SDG&E worked extensively with state and regional partners throughout this PSPS event, including extensive and multiple daily briefings with Cal OES, CPUC, Cal OES Tribal Affairs, County OES and 2-1-1. Additionally, SDG&E partnered with San Diego County OES, AFN Working Group, 2-1-1 San Diego, 2-1-1 Orange County, and community-based organizations (CBOs) to amplify key messaging through their databases and social media channels, and to translate PSPS notification into other languages. Updates on the PSPS event, including tips and a link to sign up for notifications, were sent to more than 500 community and public safety partners.

To evaluate engagement with local and state public safety partners, SDG&E holds after action events with partners at the conclusion of wildfire season. Overall, feedback has been positive following advanced outreach.

Immediately following the PSPS event, SDG&E distributed a one question online survey requesting public safety partners rate SDG&E’s level of engagement with their organization before and during the Oct. 26–27 PSPS event. SDG&E received five responses to the survey. Please see below for the results of the survey:

SDG&E Post-Event Public Safety Partner Engagement Survey Results: PSPS Event October 26–27, 2020

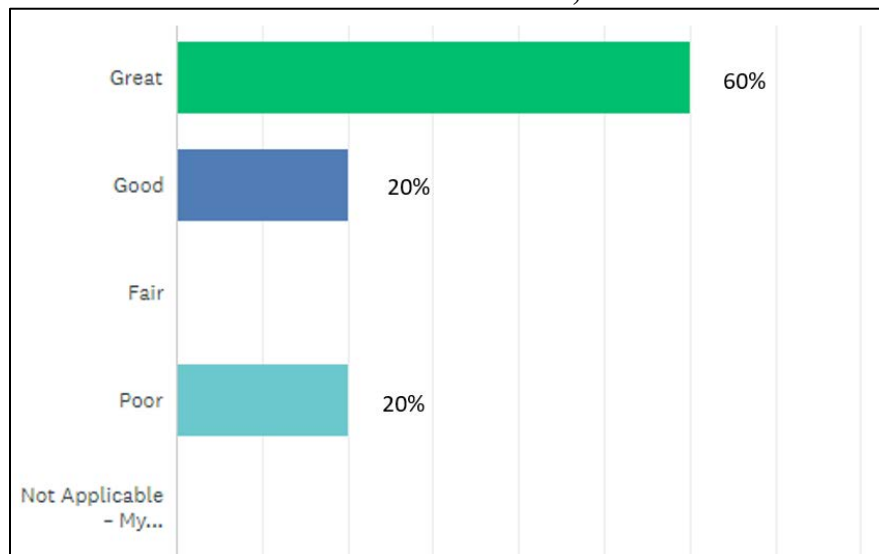

The only comment received on the survey was, “My organization was not affected.”

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

12. The local communities' representatives SDG&E contacted prior to de-energization and the date on which they were contacted.

Response:

Please see Appendix 2 for details of notifications to Public Safety and Community Partners.
Please see Appendix 4 for details of notifications to Elected Officials and Representatives.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

- 13. Summarize the number and nature of complaints received as a result of the de-energization event and include claims that are filed against SDG&E because of the de-energization.**

Response:

As of November 10, SDG&E has received two claims for food loss related to the PSPS events that took place October 26–27.

As of November 10, SDG&E has not received any complaints related to the October 26–27 PSPS event.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

14. Provide detailed timeline and description of the steps taken to restore power.

Response:

SDG&E considers and implements the following steps to restore power:

- a. Meteorology forecasted wind gusts have peaked and are trending downward;
- b. Real-time observer reports confirming no impacts to system, no debris and no vegetation impacts;
- c. Full patrol of the de-energized distribution circuit or transmission tie-line to inspect for damages;
- d. Electric Troubleshooter, observers and/or line crews on-site during re-energization process at key locations;
- e. Contract Fire-Fighting Resources (CFR) on-site during re-energization process;
- f. Check and ensure all personnel are in the clear before re-energization;
- g. Approval by OIC, Deputy Ops, and Field Utility Commander to restore device/circuit/tie-line; and
- h. Electric Distribution Operations/Electric Grid Operations notifies EOC of time reenergization was completed.

Device	De-energization date/time	Authorization to Patrol Date/time	Restoration Date/Time
520-35R	10/26/2020 8:59 a.m.	10/26/2020 1:35 p.m.	10/26/2020 4:51 p.m.
520-18R	10/26/2020 9:21 a.m.	10/26/2020 1:35 p.m.	10/26/2020 4:16 p.m.
520-26R	10/26/2020 10:50 a.m.	10/26/2020 1:35 p.m.	10/26/2020 4:26 p.m.
C1234	10/26/2020 8:51 a.m.	10/26/2020 1:35 p.m.	10/26/2020 4:40 p.m.
239-15R	10/26/2020 8:48 a.m.	10/26/2020 1:35 p.m.	10/26/2020 4:06 p.m.
445-39R	10/27/2020 9:48 a.m.	10/27/2020 12:50 p.m.	10/27/2020 4:24 p.m.
444-43R	10/27/2020 10:39 a.m.	10/27/2020 1:25 p.m.	10/27/2020 4:07 p.m.
1215-12R	10/27/2020 9:12 a.m.	10/27/2020 1:26 p.m.	10/27/2020 5:19 p.m.

At the time SDG&E determined weather conditions were safe to begin patrols for re-energization on Monday, October 26, a Marine battalion was conducting training activities on Marine Corps Air Station (MCAS) Camp Pendleton. Due to proactive communications and a positive relationship with MCAS leadership, SDG&E was able to coordinate secure entry to the air space to effectively conduct helicopter patrols without interruption of the activities at MCAS Camp Pendleton. This enabled SDG&E to restore power expeditiously, with no impact to customers.

15. Lessons learned by SDG&E from the PSPS event.

Response:

As a part of the continuous quality improvement process, SDG&E conducted several After-Action Reviews to assess potential areas for improvement. The following areas have been identified:

- Upgrades to circuit sorting criteria on PSPS dashboard did not function as anticipated, requiring usage of secondary system to ensure accuracy.
- In the virtual EOC environment, SDG&E needs to develop a more efficient way of quickly notifying key staff in the event of rapidly changing weather patterns.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

16. Recommended updates/modifications the PSPS guidelines adopted in ESRB-8, D.19-05-042, and D.20-05-051.

Response:

SDG&E sends notifications to public safety partners preceding a PSPS event at the cadences prescribed by the Commission in D.19-05-042 and D.20-05-051. These notifications include anticipated scope of the PSPS event, which SDG&E derives from weather forecasts, at the time the notification is sent.

Based on feedback from public safety partners, SDG&E recommends excluding the customer count detail in the 72-hour prior notification. Instead, SDG&E suggests this information be provided beginning at the 48-hour prior mark. Doing so would allow SDG&E to further refine the scope to provide a more finite customer count based on more accurate weather forecasts. This would also reduce the resources public safety partners expend based on the less accurate advanced scope.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

17. Include any other matters that SDG&E believes are relevant to the Commission’s assessment of the reasonableness of SDG&E’s decision to de-energize.

Response:

SDG&E does not have any other matters to share at this time.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

VERIFICATION

I am an officer of San Diego Gas & Electric Company and am authorized to make this verification on its behalf. I declare under penalty of perjury that the contents of the foregoing document are true to my own knowledge, except as to matters that are stated on information and belief, and as to those matters, I believe them to be true.

Executed this 10th day of November 2020, at San Diego, California.

John D. Jenkins
Vice President, Electric System Operations
San Diego Gas & Electric Company

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Appendix 1
Customer Communications: Dates, Times and Type

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Overview of Communications by Method

Method	Total # Notifications	Source
Cell phone	44,995	SDG&E
Email	53,050	SDG&E
Landline/Home phone	33,292	SDG&E
Text message	1,820	SDG&E
		Total: 133,157

***The total number of notifications does not represent unique customers. Some customers received notifications through multiple channels**

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Customer Notifications Detailed Communications

Message	Date	Time of First Call	Landline	Cell	Text	Email
M2: PSPS possible; 24–48 hours prior	10/24/2020	1:22 p.m.	13,699	12,968	557	15,999
M6A: PSPS possible overnight	10/25/2020	4:15 p.m.	4,242	7,130	264	8,855
M6: PSPS likely; 1–4 hours prior	10/25/2020	4:14 p.m.	7	10	3	647
M6: PSPS likely; 1–4 hours prior	10/26/2020	8:06 a.m.	1,971	4,149	170	4,251
M7: PSPS active	10/26/2020	9:28 a.m.	1,027	1,831	68	1,852
M12: Patrols for restoration started	10/26/2020	1:56 p.m.	789	1,810	69	2,087
M15: Power restored	10/26/2020	4:21 p.m.	791	1,755	67	1,744
M15A: No risk of PSPS	10/26/2020	6:03 p.m.	9,142	13,136	493	15,380
M7: PSPS active	10/27/2020	9:21 a.m.	757	1,054	66	1,060
M12: Patrols for restoration started	10/27/2020	3:23 p.m.	183	259	16	259
M15: Power restored	10/27/2020	4:23 p.m.	684	893	47	916

Message Glossary

Message	Content
M2: PSPS possible; 24–48 hours prior	<p>This is SDG&E calling with an important message. Press any key to continue.</p> <p>Alert: Forecasted weather conditions could affect the power lines that serve your community. We are currently monitoring the potential for adverse weather conditions to begin within 24 to 48 hours. These conditions may require us to turn off the power for public safety in your community. If you do experience an outage, the power will stay off until we can safely restore it. Please be prepared to activate your personal family emergency plan. For more information, visit SDGE.com/Ready</p>
M6A: PSPS possible overnight	<p>Warning: weather conditions are forecast to affect the power lines that serve your community. We are currently monitoring adverse weather conditions. These conditions may require us to activate a Public Safety Power Shutoff overnight. The power will stay off until we can safely restore it. Please prepare to activate your personal family emergency plan. For more information including anticipated duration updates, visit SDGE.com/Ready.</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Message	Content
M6: PSPS likely; 1–4 hours prior	<p>This is SDG&E calling with an important message. Press any key to continue. Warning: weather conditions are forecast to affect the power lines that serve your community. We are currently monitoring adverse weather conditions. These conditions will likely require us to activate a Public Safety Power Shutoff within the next one to four hours. The power will stay off until we can safely restore it. Please prepare to activate your personal family emergency plan. For more information including anticipated duration updates, visit SDGE.com/Ready.</p>
M7: PSPS active	<p>This is SDG&E calling with an important message. Press any key to continue.</p> <p>Notification - power is out: due to adverse weather conditions affecting power lines that serve your community, the power has been turned off for public safety. Your power could be out overnight and remain out for up to 72 hours. When conditions improve, our crews will assess the safety of the electrical system and determine when power can be restored. Your safety and the safety of your community is our highest priority. For updated information on outages and restoration times, visit SDGE.com/outages, check our mobile app, or follow us on Twitter.</p>
M12: Patrols for restoration started	<p>This is SDG&E calling with an important message. Press any key to continue.</p> <p>Conditions have improved, and SDG&E crews have begun patrolling power lines to determine when power can be restored to affected communities. Please be aware that some inspections could take place on your property. For up-to-date information on outages and restoration times, visit SDGE.com/Outages, check our mobile app, or follow us on Twitter.</p>
M15: Power restored	<p>This is SDG&E calling with an important message. Press any key to continue.</p> <p>Your power should now be fully restored. If the power is still out, please call us at 1-800-411-7343. Visit SDGENews.com for up-to-date information. We appreciate your cooperation during this time of adverse weather conditions.</p>
M15A: No risk of PSPS	<p>Adverse weather conditions have passed in your area. If you received a previous notification about a potential Public Safety Power Shutoff, you are no longer at risk of losing power. For more information, visit sdgenews.com. Thank you for your patience.</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Appendix 2

Public Safety and Community Partner Communications: Dates, Times and Recipients

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

SDG&E’s Regional Public Affairs team provided notifications to local community organizations, tribal governments, elected officials, government representatives, and local jurisdictions throughout this event.

Emergency Management team provided notifications to CalOES, CalFire, County OES, local jurisdiction Emergency Managers, and dispatch centers.







The table below includes the content of each notification sent by SDG&E’s Regional Public Affairs and Emergency Management:

Description of notification	Date/time sent	Content of notification
1. PSPS possible in 48–72 hours	10/23/2020 12:44 p.m.	<p>This is an important safety message from SDG&E.</p> <p>SDG&E is monitoring possible high fire risk weather conditions forecasted to begin within 48 to 72 hours. These conditions may force SDG&E to shut off power to reduce the risk of a wildfire. If power is shut off, we will not turn it back on until conditions are safe to do so. We know being without electricity is difficult and we appreciate your patience and partnership as we keep safety our top priority during these potential high fire risk conditions. Please monitor your email for a more detailed communication tomorrow.</p> <p>For more information, visit sdge.com. Our new Public Safety Power Shutoff mobile app is also available for download for updates for potential and active Public Safety Power Shutoff events sdge.com/PSPSApp.</p> <p>Thank you. SDG&E Liaison Officer</p>
2. PSPS possible in 24–48 hours	10/24/2020 1:10 p.m. and 2:40 p.m.	<p>This is an important safety message from SDG&E.</p> <p>SDG&E’s current forecast includes moderate to locally strong winds from the north/northeast in Orange County and northwest San Diego County overnight Sunday through Monday, with fire weather watch for Inland Orange County in effect for Monday. We anticipate that if public safety power shutoffs are required, the estimated start time of the event would be early Monday morning. We anticipate that under these conditions, the event could last through Tuesday evening.</p> <p>To protect fire-prone communities in parts of the service territory, SDG&E may activate its Emergency</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Description of notification	Date/time sent	Content of notification
		<p>Operations Center to monitor adverse weather conditions throughout the duration of this event. These conditions may require us to initiate public safety power shutoffs within the next 24-48 hours to very localized areas of the territory as a measure of last resort to reduce fire risk; the following communities may be impacted:</p> <ul style="list-style-type: none"> • Camp Pendleton • East San Juan Capistrano • Fallbrook • Oceanside • Pala Reservation • San Clemente <p>We estimate approximately 21,481 customers may be impacted, including 712 Medical Baseline (MBL) customers in the potentially impacted communities.</p> <p>If you have obtained geographic information systems (GIS) data access from SDG&E, you will be able to receive GIS data via secure data transfer. If you have not set up access or have problems accessing this link, please see Public Safety Power Shutoff map.</p> <p>SDG&E’s meteorology team is closely monitoring the weather as windy conditions elevate fire risk. The following contacts are available if you need additional information, SDGELiaisonOfficerNotifications@sdge.com or 858-503-5450, or Emergency Management Duty Officer eseodsge@sdge.com or 858-503-5173. Please do not forward this contact information beyond your government or public safety teams.</p> <p>If residents have questions, please have them call 800-411-7343 for more information and visit our website to update account information. Our new Public Safety Power Shutoff mobile app is also available for download for updates for potential and active Public Safety Power Shutoff events http://www.sdge.com/PSPSApp.</p> <p>Additionally, a flyer for posting within your community is attached.</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Description of notification	Date/time sent	Content of notification						
		<p>We will send another notification when conditions change or if we turn off power for safety. For more information, please visit SDGE.com/Ready.</p> <p>Thank you, SDG&E Liaison Officer</p> <div style="text-align: center;">  <p>IMPORTANT SAFETY MESSAGE FROM SDG&E</p> <p>Adverse weather conditions forecasted for October 26 through October 27, include increased wildfire risk that may affect the power lines serving local communities. These conditions may require us to turn off power to reduce the risk of a wildfire. If power is turned off, it will remain off until conditions are safe for restoration. When possible, we will notify potentially impacted customers at least in advance of power being turned off.</p> <p>Impacted areas</p> <p>We're currently monitoring adverse weather conditions in the following areas:</p> <table border="1" data-bbox="943 667 1219 730"> <tr><td>Carlsbad</td></tr> <tr><td>East San Juan Capistrano</td></tr> <tr><td>Escondido</td></tr> <tr><td>Encinitas</td></tr> <tr><td>San Marcos</td></tr> <tr><td>San Clemente</td></tr> </table> <p>What you need to know</p> <p>Safety is our highest priority and we understand the inconvenience you may experience as a result of possible outages. Here are some things you should know about potential power outages in your area:</p> <ul style="list-style-type: none"> We're continuously monitoring weather and wildfire risk conditions and will contact those impacted with further updates. If power is shut off, we expect to restore it within 24 to 48 hours, in most cases, after high fire risk weather conditions have passed. Depending on weather conditions, or if repairs are needed, power outages could last longer than 48 hours. For planning purposes, we encourage you to prepare for multiple day outages. <p>It's important to take proactive steps when preparing for potential power outages and other emergencies. Here are some things you can do to be more prepared:</p> <div style="display: flex; justify-content: space-around;"> <div data-bbox="943 856 1024 951">  <p>Make sure your backup generator is updated and safe to use. Follow instructions at www.sdge.com/backupgenerators.</p> </div> <div data-bbox="1040 856 1122 951">  <p>Prepare an emergency plan in case power is turned off to reduce the risk of wildfire. Learn more about what your emergency plan should include at www.sdge.com/emergencyplan.</p> </div> <div data-bbox="1138 856 1219 951">  <p>If you have a backup generator, please do a safety check and make sure you have enough fuel to last a few days. Generator safety tips can be found at www.sdge.com/generator.</p> </div> </div> <p>For additional help: Please contact SDG&E at 1-800-411-7343. If you need additional service assistance or essential resources during this time, please dial 311 to contact 3-1-1 San Diego or 3-1-1 Orange County.</p> <div style="display: flex; justify-content: center; align-items: center;">   </div> </div>	Carlsbad	East San Juan Capistrano	Escondido	Encinitas	San Marcos	San Clemente
Carlsbad								
East San Juan Capistrano								
Escondido								
Encinitas								
San Marcos								
San Clemente								
<p>3. PSPS possible in portions of the county (24-hours prior)</p>	<p>10/25/2020 12:35 p.m.</p>	<p>This is an important safety message from SDG&E.</p> <p>SDG&E’s current forecast remains relatively unchanged from yesterday and includes moderate to locally strong winds from the north/northeast in Orange County and northwest San Diego County beginning Monday morning. The National Weather Service has issued a Red Flag Warning for Inland Orange County for Monday morning through Tuesday evening and a High Wind Warning for Inland Orange County for Monday morning through Tuesday afternoon. San Diego County was not included in the Red Flag Warning but can expect breezy conditions Monday afternoon through Tuesday. We anticipate that if public safety power shutoffs are required, the estimated start time of the event would be early Monday morning and under these conditions, the event could last through Tuesday evening.</p> <p>To protect fire-prone communities in parts of the service territory, SDG&E has activated its Emergency Operations Center to monitor adverse weather conditions throughout the duration of this event. These conditions</p>						

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Description of notification	Date/time sent	Content of notification
		<p>may require us to initiate public safety power shutoffs within the next 24 hours to very localized areas of the territory as a measure of last resort to reduce fire risk; the following communities may be impacted:</p> <ul style="list-style-type: none"> • Camp Pendleton • East San Juan Capistrano • Fallbrook • Oceanside • Pala Reservation • San Clemente <p>Yesterday, SDG&E contacted 21,481 customers, including 712 Medical Baseline (MBL) customers, in the potentially impacted communities.</p> <p>If you have obtained geographic information systems (GIS) data access from SDG&E, you will be able to receive GIS data via secure data transfer. If you have not set up access or have problems accessing this link, please see Public Safety Power Shutoff map.</p> <p>SDG&E’s meteorology team is closely monitoring the weather as windy conditions elevate fire risk. The following contacts are available if you need additional information, SDGELiaisonOfficerNotifications@sdge.com or 858-503-5450, or Emergency Management Duty Officer eseodsge@sdge.com or 858-503-5173. Please do not forward this contact information beyond your government or public safety teams.</p> <p>If residents have questions, please have them call 1-800-411-7343 for more information and visit our website to update account information. Our new Public Safety Power Shutoff mobile app is also available for download for updates for potential and active Public Safety Power Shutoff events http://www.sdge.com/PSPSApp. Additionally, a flyer for posting within your community is attached.</p> <p>We will send another notification when conditions change or if we turn off power for safety. For more information, please visit SDGE.com/Ready.</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Description of notification	Date/time sent	Content of notification
		<p>Thank you, SDG&E Liaison Officer</p>
<p>4. SDG&E has shut off power for public safety</p>	<p>10/26/2020 12:59 p.m.</p>	<p>This is an important safety message from SDG&E about a public safety power shut off affecting your service. Due to high fire risk weather conditions affecting power lines serving your community, power has been shut off to reduce the risk of wildfire. Power may be out overnight and remain out for up to 72 hours.</p> <p>Communities impacted:</p> <ul style="list-style-type: none"> • Fallbrook <p>We know being without electricity is difficult and we appreciate your patience as we keep safety our top priority during these high fire risk conditions. When conditions are safe, SDG&E will inspect the power lines to make sure they are safe to operate and determine when power can be turned back on.</p> <p>The following contacts are available if you need additional information, SDGELiaisonOfficerNotifications@sdge.com or 858-503-5450, or Emergency Management Duty Officer eseods@sdge.com or 858-503-5173. Please do not forward this contact information beyond your government or public safety teams.</p> <p>If residents have questions, please have them call 1-800-411-7343 for more information and visit our website to update account information. Our new Public Safety Power Shutoff mobile app is also available for download for updates for potential and active Public Safety Power Shutoff events http://www.sdge.com/PSPSApp.</p> <p>For location details and updated information on outages and when power may be turned back on, please visit www.SDGE.com/Outages, check our PSPS app, or follow us on Twitter.</p> <p>For more information, please visit SDGE.com/Ready.</p> <p>Customers Affected: 2,908 Medical Baseline: 106</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Description of notification	Date/time sent	Content of notification
		<p>Customer Resource Centers: Vista Hermosa Sports Park in San Clemente located at 987 Avenida Vista Hermosa, San Clemente, CA 92673</p> <p>Fallbrook County Library 124 S. Mission Rd, Fallbrook, CA 92028</p> <p>Additional languages: www.SDGE.com/m8e</p> <p>Thank you, SDG&E Liaison Officer</p>
<p>5. SDG&E is determining when power can be turned back on (Fallbrook)</p>	<p>10/26/2020 2:50 p.m.</p>	<p>This is an important safety message from SDG&E about a public safety power shutoff affecting service in areas you may represent and work with.</p> <p>Weather conditions have improved, and SDG&E crews have begun inspecting power lines to make sure they are safe to operate and determining when power can be turned back on to affected communities. We understand there is no good time to be without power, and we appreciate your patience as we work as quickly and safely as possible. We do not expect to restore all customers this evening. For up-to-date information on outages and when power may be turned back on, please visit www.sdge.com/outages, check our mobile app, or follow us on Twitter. Additional languages: www.SDGE.com/m13e.</p> <p>Currently, we have 2,908 customers out of service in the Fallbrook area, including 106 medical baseline customers. The following Community Resource Center will be open until 10 p.m. Please note all Community Resource Centers are drive-thru for health reasons:</p> <p>Fallbrook County Library 124 S. Mission Road Fallbrook, CA 92028</p> <p>Thank you, SDG&E Liaison Officer</p>
<p>6. SDG&E has restored power to impacted areas (Fallbrook)</p>	<p>10/26/2020 5:46 p.m.</p>	<p>This is an important safety message from SDG&E.</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Description of notification	Date/time sent	Content of notification
		<p>We have successfully and safely restored power to impacted customers in Fallbrook and surrounding communities who were taken out of service as a result of a Public Safety Power Shutoff (PSPS). Additionally, our Customer Resource Center (CRC) has been closed for the evening.</p> <p>The following contacts are available if you need additional information, SDGELiaisonOfficerNotifications@sdge.com or 858-503-5450, or Emergency Management Duty Officer ESEODSDGE@sdge.com or 858-503-5450. Please do not forward this contact information beyond your government or public safety teams. Alternatively, you may also contact your assigned Public Affairs Manager for any questions you may have.</p> <p>If residents or your constituents have questions, please have them call 1-800-411-7343 for more information and visit our website to update account information. Our new Public Safety Power Shutoff mobile is now available for download for updates for potential and active Public Safety Power Shutoff events http://www.sdge.com/PSPSApp.</p> <p>For more information, please visit SDGE.com/Ready. Thank you for your support as we work together to keep our communities safe.</p> <p>Thank you, SDG&E Liaison Officer</p>
<p>7. SDG&E has shut of power for public safety (southeast San Diego)</p>	<p>10/27/2020 12:03 p.m.</p>	<p>This is an important safety message from SDG&E about a public safety power shut off affecting your service.</p> <p>Due to high fire risk weather conditions affecting power lines serving your community, power has been shut off to reduce the risk of wildfire. Power may be out overnight and remain out for up to 72 hours.</p> <p>Communities Impacted:</p> <ul style="list-style-type: none"> • Boulevard • Manzanita Reservation • La Posta Reservation • Campo Reservation

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Description of notification	Date/time sent	Content of notification
		<ul style="list-style-type: none"> • Jacumba (added) <p>We know being without electricity is difficult and we appreciate your patience as we keep safety your top priority during these high fire risk conditions. When conditions are safe, SDG&E will inspect the power lines to make sure they are safe to operate and determine when power can be turned back on.</p> <p>The following contacts are available if you need additional information, SDGELiaisonOfficerNotifications@sdge.com or 858-503-5450, or Emergency Management Duty Officer eseodsge@sdge.com or 858-503-5173. Please do not forward this contact information beyond your government or public safety teams.</p> <p>If residents have questions, please have them call 1-800-411-7343 for more information and visit our website to update account information. Our new Public Safety Power Shutoff mobile app is also available for download for updates for potential and active Public Safety Power Shutoff events http://www.sdge.com/PSPSApp.</p> <p>For location details and updated information on outages and when power may be turned back on, please visit www.SDGE.com/Outages, check our PSPS app, or follow us on Twitter.</p> <p>For more information, please visit SDGE.com/Ready</p> <p>Total Impacted Customers: 1466 Impacted Medical Baseline Customers: 116</p> <p>Thank you, SDG&E Liaison Officer</p>
8. SDG&E is determining when power can be turned back on (southeast San Diego)	10/27/2020 1:38 p.m. and 2:14 p.m.	<p>This is an important safety message from SDG&E about a public safety power shutoff affecting service in areas you may represent and work with.</p> <p>Weather conditions have improved, and SDG&E crews have begun inspecting power lines to make sure they are safe to operate and determining when power can be turned back on to affected communities. We understand</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Description of notification	Date/time sent	Content of notification
		<p>there is no good time to be without power, and we appreciate your patience as we work as quickly and safely as possible. We do not expect to restore all customers this evening. For up-to-date information on outages and when power may be turned back on, please visit www.sdge.com/outages, check our mobile app, or follow us on Twitter. Additional languages: www.SDGE.com/m13e.</p> <p>Currently, we have 1,466 customers out of service in the ... Boulevard and Jacumba area, including 116 medical baseline customers.</p> <p>SDG&E Liaison Officer</p>
<p>9. SDG&E has restored power to impacted areas and SDG&E's EOC has deactivated</p>	<p>10/27/2020 5:35 p.m.</p>	<p>This is an important safety message from SDG&E.</p> <p>We have successfully and safely restored power to impacted customers and surrounding communities listed who were taken out of service as a result of a Public Safety Power Shutoff (PSPS).</p> <ul style="list-style-type: none"> • Boulevard • Campo Reservation • Jacumba • La Posta Reservation • Manzanita Reservation <p>The SDG&E EOC has been deactivated.</p> <p>If residents or your constituents have questions, please have them call 1-800-411-7343 for more information and visit our website to update account information. Our new Public Safety Power Shutoff mobile is now available for download for updates for potential and active Public Safety Power Shutoff events http://www.sdge.com/PSPSApp.</p> <p>For more information, please visit SDGE.com/Ready. Thank you for your support as we work together to keep our communities safe.</p> <p>SDG&E Liaison Officer</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

See below for details related to the recipients (by title and organization/agency/tribe/jurisdiction) for each notification provided by SDG&E to public safety and community partners during this event:

1. PSPS possible in 48–72 hours: Sent Friday, October 23, at approximately 12:44 p.m.

Title (# of contacts, if applicable)	Jurisdiction/Organization
Municipal Water District of Orange County (3)	Orange County
San Diego County Deputy Sheriff's Association	County of San Diego
Fallbrook Public Utility District Sanitary	Fallbrook
Rainbow MWD	
San Diego County Water Authority (4)	San Diego County
Santa Margarita Water District	Coto De Caza
South Coast Water District	Orange County
South Orange County Water Authority	
Crisis Communications Director (2)	2-1-1 San Diego
Duty Officer	
VP of Community & Govt. Relations	
Disaster Program Manager	American Red Cross
Regional Disaster Officer	
Regional Planning & Recovery Manager	
Tribal Advisor	Cal OES Tribal Affairs
Tribal District	
PIO, Communications (14)	Caltrans
TMC Operations Engineer	
Deputy City Manager	Carlsbad
Intergovernmental Affairs Director	
Mayor	
Cox Communications	County of Orange
Sprint (3)	
T-Mobile	
Verizon Wireless (2)	
Cox Communications	County of San Diego
San Diego County Water Authority	
Sprint (3)	
T-Mobile	
Verizon Wireless (2)	
Tribal Advisor	CPUC
Councilmember	Dana Point
Deputy Public Works Director/City Engineer	
Economic Development	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Emergency Coordinator	
Executive Assistant	
Mayor	
Mayor Pro Tem	
District Director (2)	Federal
Staff Assistant	
U.S. Senator (2)	
Director of Public Works	Laguna Beach
Executive Assistant	
Mayor	
Mayor Pro Tem	
Underground Utility Manager	
Councilmember (2)	Oceanside
Deputy City Manager	
Mayor	
Orange County Fire Authority	Orange County
Director - Community Development	San Clemente
Director of Public Works/City Engineer	
Emergency Planning Officer	
Executive Assistant	
Maintenance Manager	
Mayor	
Mayor Pro Tem	
Deputy CAO - Land Use & Environmental	San Diego County
General Services (2)	
Media & Public Relations	
Parks & Recreation (2)	
Public Works	
Supervisor (2)	San Diego County Board of Supervisors
Vice Chair of the Board of Supervisors	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Councilmember (3)	San Juan Capistrano
Director of Community Services (Parks & Rec)	
Director of Development Services	
Director of Utilities/ Public Works	
HR/Risk Manager	
Mayor	
Mayor Pro Tem	
Senior Executive Assistant	
District Coordinator	State
District Director (3)	
Field Representative (2)	
Legislative Director (5)	
Senator	
Director of Operations	Tribal La Jolla
Vice Chair	
Executive Council Member (3)	Tribal Los Coyotes
Vice Chairman	Tribal Mesa Grande
Environmental Director	Tribal Pala
IT Director	
Utility Department	
Vice Chairman and Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Tribal Administrator	Tribal Pauma
Emergency Services Coordinator	Tribal Pechanga
Utilities Manager	
Group Emergency Email	Tribal Rincon
Indian Health Council (COO)	
Indian Health Council (Facilities Director)	
Public Safety Director	
Fire Chief	Tribal San Pasqual
Planning Director	
Utilities Manager	
Tribal Administrator	Tribal Santa Ysabel
Tribal Enterprise	
Councilmember (3)	Vista
Deputy Chief	
Deputy Mayor	
Mayor	
PIO, Communications Officer	
Emergency Manager	San Diego County OES
Emergency Manager (3)	San Diego County Sheriff
Dispatch Supervisor	
Dispatch Supervisor	North County Dispatch Center
Dispatch Supervisor (3)	Heartland Fire Dispatch Center
Dispatch Supervisor	SDFD Fire Dispatch Center
Dispatch Supervisor	Monte Vista Fire Dispatch Center
Emergency Manager	Sempra Utilities
Emergency Manager	CalOES
Emergency Manager	CUEA
Emergency Manager	City of Carlsbad
Emergency Manager	City of Dana Point
Emergency Manager	City of Laguna Niguel
Emergency Manager	City of San Clemente
Emergency Manager	City of San Juan Capistrano
Emergency Manager	City of Vista
Emergency Manager	City of Chula Vista
Deputy Fire Chief	
Battalion Chief	City of Coronado

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Emergency Manager	
Fire Chief	City of Imperial Beach
Asst. Fire Marshal	
Emergency Manager	City of National City
Emergency Manager	City of Poway
Fire Chief	
Emergency Manager	City of San Diego
Division Chief	City of San Marcos
Emergency Manager	
Battalion Chief	City of Santee
Fire Chief	City of Vista
Sergeant	Orange County Sheriff's Department
Emergency Manager	Orange County OES
Fire Chief	Orange County Fire Authority
Director of Communications	
Battalion Chief	City of Oceanside
Emergency Manager	
Emergency Manager	City of El Cajon
Fire Chief	
Emergency Manager	City of La Mesa
Fire Chief	
Emergency Manager	City of Lemon Grove
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

2. PSPS possible in 24–48 hours: Sent Saturday, October 24 at approximately 1:10 p.m. and 2:39 p.m.

Title (# of contacts, if applicable)	Jurisdiction/Organization
Crisis Communications Director 2	2-1-1 San Diego
Duty Officer	
VP of Community & Govt. Relations	
Disaster Program Manager	American Red Cross
Regional Disaster Officer	
Regional Planning & Recovery Manager	
Tribal Advisor	Cal OES Tribal Affairs
Tribal District	
Caltrans TMC	Caltrans
PIO, Communications (14)	
TMC Operations Engineer	
Assistant City Manager	Carlsbad
City Manager	
Council Secretary	
Councilmember (3)	
Deputy City Manager	
Intergovernmental Affairs Director	
Mayor	
Santa Margarita Water District (6)	Coto de Caza
AT&T (10)	County of San Diego
AT&T - Director of External Affairs	
AT&T - Director, External Affairs	
AT&T - Director, Regulatory Affairs	
Charter (3)	
Cox Communications	
San Diego County Water Authority	
Sprint (3)	
T-Mobile (3)	
Verizon Wireless (2)	
San Diego County Water Authority (4)	
Tribal Advisor	CPUC
CEO	Dana Point
City Attorney	
City Clerk	
City Manager	
Councilmember (2)	
Deputy Public Works Director/City Engineer	
Economic Development	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Emergency Coordinator	
Executive Assistant	
Mayor	
Mayor Pro Tem	
Fallbrook Public Utility District (FPUD) Sanitary	Fallbrook
Rainbow MWD	
Congressman	Federal
District Director (2)	
Staff Assistant (2)	
U.S. Senator	Laguna Beach
City Attorney	
City Clerk	
City Manager	
Community Development	
Councilmember (3)	
Director of Public Works	
Executive Assistant	
Mayor	
Mayor Pro Tem	
Underground Utility Manager	Laguna Niguel
CEO	
Assistant City Manager	Oceanside
City Manager	
Councilmember (4)	
Deputy City Manager	
Mayor	
Supervisor 5th District	Orange County Board of Supervisors
Municipal Water District of Orange County (3)	Orange County
South Coast Water District	
South Orange County Water Authority (3)	
Orange County Fire Authority	
AT&T (9)	
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Cox Communications	
Sprint (3)	
T-Mobile	
Verizon Wireless (2)	San Clemente
Administrative Assistant	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization	
Asst. City Manager/Finance Director		
CEO		
City Clerk		
City Treasurer		
Councilmember (2)		
Director - Community Development		
Director of Public Works/City Engineer		
Emergency Planning Officer		
Executive Assistant		
Maintenance Manager		
Mayor		
Mayor Pro Tem		
CAO		San Diego County
Deputy CAO - Land Use & Environmental		
General Services (2)		
Media & Public Relations		
Parks & Recreation (2)		
Public Works		
San Diego County Water Authority (4)	San Diego County Board of Supervisors	
Chief of Staff (3)		
Supervisor (2)		
Vice Chair of the Board of Supervisors	San Juan Capistrano	
Assistant City Manger		
CEO		
CFO/ Finance Director		
City Attorney		
City Clerk		
City Manager		
Councilmember (3)		
Director of Community Services (Parks & Rec)		
Director of Development Services		
Director of Utilities/ Public Works		
HR/Risk Manager		
Mayor		
Mayor Pro Tem		
Senior Executive Assistant	San Juan Capistrano CERT	
Chair		
Regional VP- External Relations	Sempra	
Director - Federal Governmental Affairs		

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
VP-Federal Governmental Affairs	
Assemblymember (3)	State
Chief of Staff (3)	
Communications Director (2)	
District Coordinator	
District Director (3)	
Field Representative (2)	
Legislative Director (5)	
Senator	
Chairman	
Councilman	Tribal La Jolla
Director of Operations	
Vice Chair	
Chairman	Tribal Los Coyotes
Council Member (2)	
Executive Council Member (3)	
Chairman	Tribal Mesa Grande
Vice Chairman	
Chairman	Tribal Pala
Environmental Director	
IT Director	
Utility Department	
Vice Chairman and Fire Chief	Tribal Pauma
Chairman	
Tribal Administrator	Tribal Pechanga
Emergency Services Coordinator	
Utilities Manager	Tribal Rincon
Chairman	
Group Emergency Email	
Indian Health Council (COO)	
Indian Health Council (Facilities Director)	
Public Safety Director	Tribal San Pasqual
Chairman	
Chief of Police	
COO	
Fire Chief	
Planning Director	
Utilities Manager	
Chairwoman	
Tribal Administrator	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Tribal Enterprise	
Assistant City Manager	Vista
Assistant to City Manager	
City Manager	
Community Development Director	
Councilmember (3)	
Deputy Chief	
Deputy Mayor	
Mayor	
PIO, Communications Officer	
Emergency Manager	
Emergency Manager (3)	San Diego County Sheriff
Dispatch Supervisor	
Dispatch Supervisor	North County Dispatch Center
Dispatch Supervisor (3)	Heartland Fire Dispatch Center
Dispatch Supervisor	SDFD Fire Dispatch Center
Dispatch Supervisor	Monte Vista Fire Dispatch Center
Emergency Manager	Sempre Utilities
Emergency Manager	CalOES
Emergency Manager	CUEA
Emergency Manager	City of Carlsbad
Emergency Manager	City of Dana Point
Emergency Manager	City of Laguna Niguel
Emergency Manager	City of San Clemente
Emergency Manager	City of San Juan Capistrano
Emergency Manager	City of Vista
Emergency Manager	City of Chula Vista
Deputy Fire Chief	
Battalion Chief	City of Coronado
Emergency Manager	
Fire Chief	City of Imperial Beach
Asst. Fire Marshal	
Emergency Manager	City of National City
Emergency Manager	City of Poway
Fire Chief	
Emergency Manager	City of San Diego
Division Chief	City of San Marcos
Emergency Manager	
Battalion Chief	City of Santee

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Fire Chief	City of Vista
Sergeant	Orange County Sheriff's Department
Emergency Manager	Orange County OES
Fire Chief	Orange County Fire Authority
Director of Communications	
Battalion Chief	City of Oceanside
Emergency Manager	
Emergency Manager	City of El Cajon
Fire Chief	
Emergency Manager	City of La Mesa
Fire Chief	
Emergency Manager	City of Lemon Grove
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

3. PSPS possible in portions of the county: Sent Sunday, October 25, at approximately 12:35 p.m.

Title (# of contacts, if applicable)	Jurisdiction/Organization
Crisis Communications Director 2	2-1-1 San Diego
Duty Officer	
VP of Community & Govt. Relations	
Disaster Program Manager	American Red Cross
Regional Disaster Officer	
Regional Planning & Recovery Manager	
Caltrans TMC	Caltrans
PIO, Communications (14)	
TMC Operations Engineer	
Santa Margarita Water District (6)	Coto de Caza
AT&T (9)	Orange County
South Orange County Water Authority (3)	
Municipal Water District of Orange County (3)	
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Cox Communications	
Sprint (3)	
T-Mobile (3)	
Orange County Fire Authority	
Verizon Wireless	
AT&T (10)	
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Charter (3)	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Cox Communications	
Sprint (3)	
T-Mobile	
San Diego County Deputy Sheriff's Association	
San Diego County Water Authority (4)	
Verizon Wireless (5)	
CEO	Dana Point
City Attorney	
City Clerk	
City Manager	
Councilmember (2)	
Deputy Public Works Director/City Engineer	
Economic Development	
Emergency Coordinator	
Executive Assistant	
Mayor	
Mayor Pro Tem	
Fallbrook Public Utility District (FPUD) Sanitary	Fallbrook
Rainbow MWD	
Congressman	Federal
District Director (2)	
Staff Assistant (2)	
U.S. Senator	
City Attorney	Laguna Beach
City Clerk	
City Manager	
Community Development	
Councilmember (3)	
Director of Public Works	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization	
Executive Assistant		
Mayor		
Mayor Pro Tem		
Underground Utility Manager		
CEO	Laguna Niguel	
Supervisor 5th District	Orange County Board of Supervisors	
Asst. City Manager/Finance Director	San Clemente	
CEO		
City Clerk		
City Treasurer		
Councilmember (2)		
Director - Community Development		
Director of Public Works/City Engineer		
Emergency Planning Officer		
Executive Assistant		
Maintenance Manager		
Mayor		
Mayor Pro Tem		
CAO		San Diego County
Deputy CAO - Land Use & Environmental		
General Services (2)		
Media & Public Relations		
Parks & Recreation (2)		
Public Works		
Verizon Wireless		
AT&T (7)		
San Diego County Water Authority (4)	San Diego County Board of Supervisors	
Chief of Staff (3)		
Supervisor (2)		
Vice Chair of the Board of Supervisors		
Assistant City Manger	San Juan Capistrano	
CEO		
CFO/ Finance Director		
City Attorney		
City Clerk		

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization	
City Manager		
Councilmember		
Councilmember (2)		
Director of Community Services (Parks & Rec)		
Director of Development Services		
Director of Utilities/ Public Works		
HR/Risk Manager		
Mayor		
Mayor Pro Tem		
Senior Executive Assistant		
Chair		San Juan Capistrano CERT
Regional VP- External Relations	Sempra	
Director - Federal Governmental Affairs		
VP-Federal Governmental Affairs		
Assemblymember (3)		
Chief of Staff (3)		
Chief of Staff (3)		
Communications Director (2)		
District Coordinator		
District Director (3)		
Field Representative (2)		
Legislative Director (5)		
Senator		
Emergency Manager		San Diego County OES
Emergency Manager (3)		San Diego County Sheriff
Dispatch Supervisor		
Dispatch Supervisor	North County Dispatch Center	
Dispatch Supervisor (3)	Heartland Fire Dispatch Center	
Dispatch Supervisor	SDFD Fire Dispatch Center	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Dispatch Supervisor	Monte Vista Fire Dispatch Center
Emergency Manager	Sempra Utilities
Emergency Manager	CalOES
Emergency Manager	CUEA
Emergency Manager	City of Carlsbad
Emergency Manager	City of Dana Point
Emergency Manager	City of Laguna Niguel
Emergency Manager	City of San Clemente
Emergency Manager	City of San Juan Capistrano
Emergency Manager	City of Vista
Emergency Manager	City of Chula Vista
Deputy Fire Chief	
Battalion Chief	City of Coronado
Emergency Manager	
Fire Chief	City of Imperial Beach
Asst. Fire Marshal	
Emergency Manager	City of National City
Emergency Manager	City of Poway
Fire Chief	
Emergency Manager	City of San Diego
Division Chief	City of San Marcos
Emergency Manager	
Battalion Chief	City of Santee
Fire Chief	City of Vista
Sergeant	Orange County Sheriff's Department
Emergency Manager	Orange County OES
Fire Chief	Orange County Fire Authority
Director of Communications	
Battalion Chief	City of Oceanside
Emergency Manager	
Emergency Manager	City of El Cajon
Fire Chief	
Emergency Manager	City of La Mesa
Fire Chief	
Emergency Manager	City of Lemon Grove
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

4. SDG&E has shut off power for public safety: Sent Monday, October 26, at approximately 12:59 p.m.

Title (# of contacts, if applicable)	Jurisdiction/Organization	
Crisis Communications Director 2	2-1-1 San Diego	
Duty Officer		
VP of Community & Govt. Relations		
Disaster Program Manager	American Red Cross	
Regional Disaster Officer		
Regional Planning & Recovery Manager		
Caltrans TMC	Caltrans	
PIO, Communications (14)		
TMC Operations Engineer		
Santa Margarita Water District (6)	Coto de Caza	
AT&T (9)	Orange County	
South Orange County Water Authority (3)		
Municipal Water District of Orange County (3)		
AT&T - Director of External Affairs (2)		
AT&T - Director, Regulatory Affairs		
Cox Communications		
Sprint (3)		
T-Mobile (3)		
Orange County Fire Authority		
Verizon Wireless		
AT&T (10)		County of San Diego
AT&T - Director of External Affairs (2)		
AT&T - Director, Regulatory Affairs		
Charter (3)		
Cox Communications		
Sprint (3)		
T-Mobile		

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
San Diego County Deputy Sheriff's Association	
San Diego County Water Authority (4)	
Verizon Wireless (5)	
CEO	Dana Point
City Attorney	
City Clerk	
City Manager	
Councilmember (2)	
Deputy Public Works Director/City Engineer	
Economic Development	
Emergency Coordinator	
Executive Assistant	
Mayor	
Mayor Pro Tem	
Fallbrook Public Utility District (FPUD) Sanitary	Fallbrook
Rainbow MWD	
Congressman	Federal
District Director (2)	
Staff Assistant (2)	
U.S. Senator	
City Attorney	Laguna Beach
City Clerk	
City Manager	
Community Development	
Councilmember (3)	
Director of Public Works	
Executive Assistant	
Mayor	
Mayor Pro Tem	
Underground Utility Manager	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization	
CEO	Laguna Niguel	
Supervisor 5th District	Orange County Board of Supervisors	
Asst. City Manager/Finance Director	San Clemente	
CEO		
City Clerk		
City Treasurer		
Councilmember (2)		
Director - Community Development		
Director of Public Works/City Engineer		
Emergency Planning Officer		
Executive Assistant		
Maintenance Manager		
Mayor		
Mayor Pro Tem		
CAO		San Diego County
Deputy CAO - Land Use & Environmental		
General Services (2)		
Media & Public Relations		
Parks & Recreation (2)		
Public Works		
Verizon Wireless		
AT&T (7)		
San Diego County Water Authority (4)	San Diego County Board of Supervisors	
Chief of Staff (3)		
Supervisor (2)		
Vice Chair of the Board of Supervisors	San Juan Capistrano	
Assistant City Manger		
CEO		
CFO/ Finance Director		
City Attorney		
City Clerk		
City Manager		
Councilmember		
Councilmember (2)		

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Director of Community Services (Parks & Rec)	
Director of Development Services	
Director of Utilities/ Public Works	
HR/Risk Manager	
Mayor	
Mayor Pro Tem	
Senior Executive Assistant	
Chair	San Juan Capistrano CERT
Regional VP- External Relations	
Director - Federal Governmental Affairs	Sempra
VP-Federal Governmental Affairs	
Assemblymember (3)	
Chief of Staff (3)	
Communications Director (2)	
District Coordinator	State
District Director (3)	
Field Representative (2)	
Legislative Director (5)	
Senator	
Emergency Manager	San Diego County OES
Emergency Manager (3)	
Dispatch Supervisor	San Diego County Sheriff
Dispatch Supervisor	North County Dispatch Center
Dispatch Supervisor (3)	Heartland Fire Dispatch Center
Dispatch Supervisor	SDFD Fire Dispatch Center
Dispatch Supervisor	Monte Vista Fire Dispatch Center
Emergency Manager	Sempra Utilities

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Emergency Manager	CalOES
Emergency Manager	CUEA
Emergency Manager	City of Carlsbad
Emergency Manager	City of Dana Point
Emergency Manager	City of Laguna Niguel
Emergency Manager	City of San Clemente
Emergency Manager	City of San Juan Capistrano
Emergency Manager	City of Vista
Emergency Manager	City of Chula Vista
Deputy Fire Chief	
Battalion Chief	City of Coronado
Emergency Manager	
Fire Chief	City of Imperial Beach
Asst. Fire Marshal	
Emergency Manager	City of National City
Emergency Manager	City of Poway
Fire Chief	
Emergency Manager	City of San Diego
Division Chief	City of San Marcos
Emergency Manager	
Battalion Chief	City of Santee
Fire Chief	City of Vista
Sergeant	Orange County Sheriff's Department
Emergency Manager	Orange County OES
Fire Chief	Orange County Fire Authority
Director of Communications	
Battalion Chief	City of Oceanside
Emergency Manager	
Emergency Manager	City of El Cajon
Fire Chief	
Emergency Manager	City of La Mesa
Fire Chief	
Emergency Manager	City of Lemon Grove
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

5. SDG&E is determining when power can be turned back on: Sent Monday, October 26, at approximately 2:50 p.m.

Title (# of contacts, if applicable)	Jurisdiction/Organization
Crisis Communications Director 2	2-1-1 San Diego
Duty Officer	
VP of Community & Govt. Relations	
Disaster Program Manager	American Red Cross
Regional Disaster Officer	
Regional Planning & Recovery Manager	
Caltrans TMC	Caltrans
PIO, Communications (14)	
TMC Operations Engineer	
Santa Margarita Water District (6)	Coto de Caza
AT&T (9)	Orange County
South Orange County Water Authority (3)	
Municipal Water District of Orange County (3)	
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Cox Communications	
Sprint (3)	
T-Mobile (3)	
Orange County Fire Authority	
Verizon Wireless	
AT&T (10)	
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Charter (3)	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Cox Communications	
Sprint (3)	
T-Mobile	
San Diego County Deputy Sheriff's Association	
San Diego County Water Authority (4)	
Verizon Wireless (5)	
CEO	Dana Point
City Attorney	
City Clerk	
City Manager	
Councilmember (2)	
Deputy Public Works Director/City Engineer	
Economic Development	
Emergency Coordinator	
Executive Assistant	
Mayor	
Mayor Pro Tem	
Fallbrook Public Utility District (FPUD) Sanitary	Fallbrook
Rainbow MWD	
Congressman	Federal
District Director (2)	
Staff Assistant (2)	
U.S. Senator	
City Attorney	Laguna Beach
City Clerk	
City Manager	
Community Development	
Councilmember (3)	
Director of Public Works	
Executive Assistant	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization	
Mayor		
Mayor Pro Tem		
Underground Utility Manager		
CEO	Laguna Niguel	
Supervisor 5th District	Orange County Board of Supervisors	
Asst. City Manager/Finance Director	San Clemente	
CEO		
City Clerk		
City Treasurer		
Councilmember (2)		
Director - Community Development		
Director of Public Works/City Engineer		
Emergency Planning Officer		
Executive Assistant		
Maintenance Manager		
Mayor		
Mayor Pro Tem		
CAO		San Diego County
Deputy CAO - Land Use & Environmental		
General Services (2)		
Media & Public Relations		
Parks & Recreation (2)		
Public Works		
Verizon Wireless		
AT&T (7)		
San Diego County Water Authority (4)		
Chief of Staff (3)	San Diego County Board of Supervisors	
Supervisor (2)		
Vice Chair of the Board of Supervisors		
Assistant City Manger	San Juan Capistrano	
CEO		
CFO/ Finance Director		
City Attorney		
City Clerk		
City Manager		

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Councilmember	
Councilmember (2)	
Director of Community Services (Parks & Rec)	
Director of Development Services	
Director of Utilities/ Public Works	
HR/Risk Manager	
Mayor	
Mayor Pro Tem	
Senior Executive Assistant	
Chair	San Juan Capistrano CERT
Regional VP- External Relations	Sempra
Director - Federal Governmental Affairs	
VP-Federal Governmental Affairs	State
Assemblymember (3)	
Chief of Staff (3)	
Communications Director (2)	
District Coordinator	
District Director (3)	
Field Representative (2)	
Legislative Director (5)	
Senator	
Emergency Manager	San Diego County OES
Emergency Manager (3)	San Diego County Sheriff
Dispatch Supervisor	
Dispatch Supervisor	North County Dispatch Center
Dispatch Supervisor (3)	Heartland Fire Dispatch Center
Dispatch Supervisor	SDFD Fire Dispatch Center

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Dispatch Supervisor	Monte Vista Fire Dispatch Center
Emergency Manager	Sempra Utilities
Emergency Manager	CalOES
Emergency Manager	CUEA
Emergency Manager	City of Carlsbad
Emergency Manager	City of Dana Point
Emergency Manager	City of Laguna Niguel
Emergency Manager	City of San Clemente
Emergency Manager	City of San Juan Capistrano
Emergency Manager	City of Vista
Emergency Manager	City of Chula Vista
Deputy Fire Chief	
Battalion Chief	City of Coronado
Emergency Manager	
Fire Chief	City of Imperial Beach
Asst. Fire Marshal	
Emergency Manager	City of National City
Emergency Manager	City of Poway
Fire Chief	
Emergency Manager	City of San Diego
Division Chief	City of San Marcos
Emergency Manager	
Battalion Chief	City of Santee
Fire Chief	City of Vista
Sergeant	Orange County Sheriff's Department
Emergency Manager	Orange County OES
Fire Chief	Orange County Fire Authority
Director of Communications	
Battalion Chief	City of Oceanside
Emergency Manager	
Emergency Manager	City of El Cajon
Fire Chief	
Emergency Manager	City of La Mesa
Fire Chief	
Emergency Manager	City of Lemon Grove
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

6. SDG&E has restored power to impacted areas: Sent Monday, October 26, at approximately 5:46 p.m.

Title (# of contacts, if applicable)	Jurisdiction/Organization
Crisis Communications Director 2	2-1-1 San Diego
Duty Officer	
VP of Community & Govt. Relations	
Disaster Program Manager	American Red Cross
Regional Disaster Officer	
Regional Planning & Recovery Manager	
Caltrans TMC	Caltrans
PIO, Communications (14)	
TMC Operations Engineer	
Santa Margarita Water District (6)	Coto de Caza
AT&T (9)	Orange County
South Orange County Water Authority (3)	
Municipal Water District of Orange County (3)	
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Cox Communications	
Sprint (3)	
T-Mobile (3)	
Orange County Fire Authority	
Verizon Wireless	
AT&T (10)	County of San Diego
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Charter (3)	
Cox Communications	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Sprint (3)	
T-Mobile	
San Diego County Deputy Sheriff's Association	
San Diego County Water Authority (4)	
Verizon Wireless (5)	
CEO	Dana Point
City Attorney	
City Clerk	
City Manager	
Councilmember (2)	
Deputy Public Works Director/City Engineer	
Economic Development	
Emergency Coordinator	
Executive Assistant	
Mayor	
Mayor Pro Tem	Fallbrook
Fallbrook Public Utility District (FPUD) Sanitary	
Rainbow MWD	Federal
Congressman	
District Director (2)	
Staff Assistant (2)	
U.S. Senator	Laguna Beach
City Attorney	
City Clerk	
City Manager	
Community Development	
Councilmember (3)	
Director of Public Works	
Executive Assistant	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization	
Mayor		
Mayor Pro Tem		
Underground Utility Manganer		
CEO	Laguna Niguel	
Supervisor 5th District	Orange County Board of Supervisors	
Asst. City Manager/Finance Director	San Clemente	
CEO		
City Clerk		
City Treasurer		
Councilmember (2)		
Director - Community Development		
Director of Public Works/City Engineer		
Emergency Planning Officer		
Executive Assistant		
Maintenance Manager		
Mayor		
Mayor Pro Tem		
CAO		San Diego County
Deputy CAO - Land Use & Environmental		
General Services (2)		
Media & Public Relations		
Parks & Recreation (2)		
Public Works		
Verizon Wireless		
AT&T (7)		
San Diego County Water Authority (4)		
Chief of Staff (3)	San Diego County Board of Supervisors	
Supervisor (2)		
Vice Chair of the Board of Supervisors		
Assistant City Manger	San Juan Capistrano	
CEO		
CFO/ Finance Director		
City Attorney		
City Clerk		
City Manager		
Councilmember		

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Councilmember (2)	
Director of Community Services (Parks & Rec)	
Director of Development Services	
Director of Utilities/ Public Works	
HR/Risk Manager	
Mayor	
Mayor Pro Tem	
Senior Executive Assistant	
Chair	
Regional VP- External Relations	Sempra
Director - Federal Governmental Affairs	
VP-Federal Governmental Affairs	
Assemblymember (3)	State
Chief of Staff (3)	
Communications Director (2)	
District Coordinator	
District Director (3)	
Field Representative (2)	
Legislative Director (5)	
Senator	
Emergency Manager	
Emergency Manager (3)	San Diego County Sheriff
Dispatch Supervisor	
Dispatch Supervisor	North County Dispatch Center
Dispatch Supervisor (3)	Heartland Fire Dispatch Center
Dispatch Supervisor	SDFD Fire Dispatch Center
Dispatch Supervisor	Monte Vista Fire Dispatch Center

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Emergency Manager	Sempra Utilities
Emergency Manager	CalOES
Emergency Manager	CUEA
Emergency Manager	City of Carlsbad
Emergency Manager	City of Dana Point
Emergency Manager	City of Laguna Niguel
Emergency Manager	City of San Clemente
Emergency Manager	City of San Juan Capistrano
Emergency Manager	City of Vista
Emergency Manager	City of Chula Vista
Deputy Fire Chief	
Battalion Chief	City of Coronado
Emergency Manager	
Fire Chief	City of Imperial Beach
Asst. Fire Marshal	
Emergency Manager	City of National City
Emergency Manager	City of Poway
Fire Chief	
Emergency Manager	City of San Diego
Division Chief	City of San Marcos
Emergency Manager	
Battalion Chief	City of Santee
Fire Chief	City of Vista
Sergeant	Orange County Sheriff's Department
Emergency Manager	Orange County OES
Fire Chief	Orange County Fire Authority
Director of Communications	
Battalion Chief	City of Oceanside
Emergency Manager	
Emergency Manager	City of El Cajon
Fire Chief	
Emergency Manager	City of La Mesa
Fire Chief	
Emergency Manager	City of Lemon Grove
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

7. SDG&E has shut of power for public safety: Sent Tuesday, October 27, at approximately 12:03 p.m.

Title (# of contacts, if applicable)	Jurisdiction/Organization
Public Safety Director	AT&T
Crisis Communications Director 2	2-1-1 San Diego
Duty Officer	
VP of Community & Govt. Relations	
Disaster Program Manager	American Red Cross
Regional Disaster Officer	
Regional Planning & Recovery Manager	
Tribal Advisor	Cal OES Tribal Affairs
Tribal District	
Caltrans TMC	Caltrans
PIO, Communications (14)	
TMC Operations Engineer	
AT&T (9)	Orange County
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Cox Communications	
Sprint (3)	
T-Mobile	
South Orange County Water Authority (3)	
Municipal Water District of Orange County (3)	
South Coast Water District	
Verizon Wireless (2)	
Santa Margarita Water District (6)	Coto de Caza
AT&T (10)	County of San Diego
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Charter (3)	
Cox Communications	
Sprint (3)	
T-Mobile	
Verizon Wireless (2)	
Tribal Advisor	CPUC
Fallbrook Public Utility District (FPUD) Sanitary	Fallbrook
Rainbow MWD	
Congressman	Federal
District Chief of Staff	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
District Director	
Field Representative	
Staff Assistant (2)	
Chair of the Board of Supervisors	San Diego County Board of Supervisors
Chief of Staff (5)	
Supervisor (3)	
Vice Chair of the Board of Supervisors	
Regional VP- External Relations	Sempra
Director - Federal Governmental Affairs	
VP-Federal Governmental Affairs	
Assemblymember	State
Capitol Director	
Chief of Staff (2)	
Deputy Chief of Staff	
Director of Community Outreach	
Legislative Director	
Senator	
Councilman (2)	
Councilwoman	Tribal Barona
Director of Government Affairs	
Director Public Works	
Vice Chairman	
Chairman	Tribal Campo
Vice Chairwoman	
CEO	Tribal Ewiiapaayap
Indian Health Council	
Southern Indian Health Council	
Southern Indian Health Council (COO)	Tribal Inaja-Cosmit
Vice Chairwoman	
Chairwoman	Tribal Jamul
Secretary	
Councilman	Tribal La Posta
Vice Chairman	
Administrator	Tribal Manzanita
Chairwoman	
Executive Council Member	
Chairman	Tribal Sycuan
Chief Administrative Officer	
Distribution List - Facilities	
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Planning & Development Manager	
Chairman	Tribal Viejas
Councilman	
Resource Project Officer	
Secretary (2)	
Vice Chairman	
Emergency Manager	San Diego County OES
Emergency Manager (3)	San Diego County Sheriff
Dispatch Supervisor	
Dispatch Supervisor	North County Dispatch Center
Dispatch Supervisor (3)	Heartland Fire Dispatch Center
Dispatch Supervisor	SDFD Fire Dispatch Center
Dispatch Supervisor	Monte Vista Fire Dispatch Center
Emergency Manager	Sempre Utilities
Emergency Manager	CalOES
Emergency Manager	CUEA
Emergency Manager	City of Carlsbad
Emergency Manager	City of Dana Point
Emergency Manager	City of Laguna Niguel
Emergency Manager	City of San Clemente
Emergency Manager	City of San Juan Capistrano
Emergency Manager	City of Vista
Emergency Manager	City of Chula Vista
Deputy Fire Chief	
Battalion Chief	City of Coronado
Emergency Manager	
Fire Chief	City of Imperial Beach
Asst. Fire Marshal	
Emergency Manager	City of National City
Emergency Manager	City of Poway
Fire Chief	
Emergency Manager	City of San Diego
Division Chief	City of San Marcos
Emergency Manager	
Battalion Chief	City of Santee
Fire Chief	City of Vista
Sergeant	Orange County Sheriff's Department
Emergency Manager	Orange County OES
Fire Chief	Orange County Fire Authority

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Director of Communications	
Battalion Chief	City of Oceanside
Emergency Manager	
Emergency Manager	City of El Cajon
Fire Chief	
Emergency Manager	City of La Mesa
Fire Chief	
Emergency Manager	City of Lemon Grove
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

8. SDG&E is determining when power can be turned back on: Sent Tuesday, October 27, at approximately 1:38 p.m. and 2:14 p.m.

Title (# of contacts, if applicable)	Jurisdiction/Organization
Public Safety Director	AT&T
Crisis Communications Director 2	2-1-1 San Diego
Duty Officer	
VP of Community & Govt. Relations	
Disaster Program Manager	American Red Cross
Regional Disaster Officer	
Regional Planning & Recovery Manager	
Tribal Advisor	Cal OES Tribal Affairs
Tribal District	
Caltrans TMC	Caltrans
PIO, Communications (14)	
TMC Operations Engineer	
AT&T (9)	Orange County
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Cox Communications	
Sprint (3)	
T-Mobile	
South Orange County Water Authority (3)	
Municipal Water District of Orange County (3)	
South Coast Water District	
Verizon Wireless (2)	
Santa Margarita Water District (6)	Coto de Caza
AT&T (10)	County of San Diego
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Charter (3)	
Cox Communications	
Sprint (3)	
T-Mobile	
Verizon Wireless (2)	
Tribal Advisor	CPUC
Fallbrook Public Utility District (FPUD) Sanitary	Fallbrook
Rainbow MWD	
Congressman	Federal
District Chief of Staff	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
District Director	
Field Representative	
Staff Assistant (2)	
Chair of the Board of Supervisors	San Diego County Board of Supervisors
Chief of Staff (5)	
Supervisor (3)	
Vice Chair of the Board of Supervisors	
Regional VP- External Relations	Sempra
Director - Federal Governmental Affairs	
VP-Federal Governmental Affairs	
Assemblymember	State
Capitol Director	
Chief of Staff (2)	
Deputy Chief of Staff	
Director of Community Outreach	
Legislative Director	
Senator	
Councilman (2)	
Councilwoman	Tribal Barona
Director of Government Affairs	
Director Public Works	
Vice Chairman	
Chairman	Tribal Campo
Vice Chairwoman	
CEO	Tribal Ewiiapaayap
Indian Health Council	
Southern Indian Health Council	
Southern Indian Health Council (COO)	Tribal Inaja-Cosmit
Vice Chairwoman	
Chairwoman	Tribal Jamul
Secretary	
Councilman	Tribal La Posta
Vice Chairman	
Administrator	Tribal Manzanita
Chairwoman	
Executive Council Member	
Chairman	Tribal Sycuan
Chief Administrative Officer	
Distribution List - Facilities	
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Planning & Development Manager	
Chairman	Tribal Viejas
Councilman	
Resource Project Officer	
Secretary	
Vice Chairman	
Emergency Manager	San Diego County OES
Emergency Manager (3)	San Diego County Sheriff
Dispatch Supervisor	
Dispatch Supervisor	North County Dispatch Center
Dispatch Supervisor (3)	Heartland Fire Dispatch Center
Dispatch Supervisor	SDFD Fire Dispatch Center
Dispatch Supervisor	Monte Vista Fire Dispatch Center
Emergency Manager	Sempre Utilities
Emergency Manager	CalOES
Emergency Manager	CUEA
Emergency Manager	City of Carlsbad
Emergency Manager	City of Dana Point
Emergency Manager	City of Laguna Niguel
Emergency Manager	City of San Clemente
Emergency Manager	City of San Juan Capistrano
Emergency Manager	City of Vista
Emergency Manager	
Deputy Fire Chief	City of Chula Vista
Battalion Chief	City of Coronado
Emergency Manager	
Fire Chief	City of Imperial Beach
Asst. Fire Marshal	
Emergency Manager	City of National City
Emergency Manager	City of Poway
Fire Chief	
Emergency Manager	City of San Diego
Division Chief	City of San Marcos
Emergency Manager	
Battalion Chief	City of Santee
Fire Chief	City of Vista
Sergeant	Orange County Sheriff's Department
Emergency Manager	Orange County OES
Fire Chief	Orange County Fire Authority

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Director of Communications	
Battalion Chief	City of Oceanside
Emergency Manager	
Emergency Manager	City of El Cajon
Fire Chief	
Emergency Manager	City of La Mesa
Fire Chief	
Emergency Manager	City of Lemon Grove
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

**9. SDG&E has restored power to impacted areas and SDG&E’s EOC has deactivated:
Sent Tuesday, October 27, at approximately 5:35 p.m.**

Title (# of contacts, if applicable)	Jurisdiction/Organization
Public Safety Director	AT&T
Crisis Communications Director 2	2-1-1 San Diego
Duty Officer	
VP of Community & Govt. Relations	
Disaster Program Manager	American Red Cross
Regional Disaster Officer	
Regional Planning & Recovery Manager	
Tribal Advisor	Cal OES Tribal Affairs
Tribal District	
Caltrans TMC	Caltrans
PIO, Communications (14)	
TMC Operations Engineer	
AT&T (9)	Orange County
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Cox Communications	
Sprint (3)	
T-Mobile	
South Orange County Water Authority (3)	
Municipal Water District of Orange County (3)	
South Coast Water District	
Verizon Wireless (2)	
Santa Margarita Water District (6)	Coto de Caza
AT&T (10)	County of San Diego
AT&T - Director of External Affairs (2)	
AT&T - Director, Regulatory Affairs	
Charter (3)	
Cox Communications	
Sprint (3)	
T-Mobile	
Verizon Wireless (2)	
Tribal Advisor	CPUC
Fallbrook Public Utility District (FPUD) Sanitary	Fallbrook
Rainbow MWD	
Congressman	Federal
District Chief of Staff	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
District Director	
Field Representative	
Staff Assistant (2)	
Chair of the Board of Supervisors	San Diego County Board of Supervisors
Chief of Staff (5)	
Supervisor (3)	
Vice Chair of the Board of Supervisors	
Regional VP- External Relations	Sempra
Director - Federal Governmental Affairs	
VP-Federal Governmental Affairs	
Assemblymember	State
Capitol Director	
Chief of Staff (2)	
Deputy Chief of Staff	
Director of Community Outreach	
Legislative Director	
Senator	
Councilman (2)	
Councilwoman	Tribal Barona
Director of Government Affairs	
Director Public Works	
Vice Chairman	
Chairman	Tribal Campo
Vice Chairwoman	
CEO	Tribal Ewiiapaayap
Indian Health Council	
Southern Indian Health Council	
Southern Indian Health Council (COO)	Tribal Inaja-Cosmit
Vice Chairwoman	
Chairwoman	Tribal Jamul
Secretary	
Councilman	Tribal La Posta
Vice Chairman	
Administrator	Tribal Manzanita
Chairwoman	
Executive Council Member	
Chairman	Tribal Sycuan
Chief Administrative Officer	
Distribution List - Facilities	
Fire Chief	

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Planning & Development Manager	
Chairman	Tribal Viejas
Councilman	
Resource Project Officer	
Secretary	
Vice Chairman	
Emergency Manager	San Diego County OES
Emergency Manager (3)	San Diego County Sheriff
Dispatch Supervisor	
Dispatch Supervisor	North County Dispatch Center
Dispatch Supervisor (3)	Heartland Fire Dispatch Center
Dispatch Supervisor	SDFD Fire Dispatch Center
Dispatch Supervisor	Monte Vista Fire Dispatch Center
Emergency Manager	Semprea Utilities
Emergency Manager	CalOES
Emergency Manager	CUEA
Emergency Manager	City of Carlsbad
Emergency Manager	City of Dana Point
Emergency Manager	City of Laguna Niguel
Emergency Manager	City of San Clemente
Emergency Manager	City of San Juan Capistrano
Emergency Manager	City of Vista
Emergency Manager	
Deputy Fire Chief	City of Chula Vista
Battalion Chief	City of Coronado
Emergency Manager	
Fire Chief	City of Imperial Beach
Asst. Fire Marshal	
Emergency Manager	City of National City
Emergency Manager	City of Poway
Fire Chief	
Emergency Manager	City of San Diego
Division Chief	City of San Marcos
Emergency Manager	
Battalion Chief	City of Santee
Fire Chief	City of Vista
Sergeant	Orange County Sheriff's Department
Emergency Manager	Orange County OES
Fire Chief	Orange County Fire Authority

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Title (# of contacts, if applicable)	Jurisdiction/Organization
Director of Communications	
Battalion Chief	City of Oceanside
Emergency Manager	
Emergency Manager	City of El Cajon
Fire Chief	
Emergency Manager	City of La Mesa
Fire Chief	
Emergency Manager	City of Lemon Grove
Fire Chief	

Appendix 3
CPUC Notifications: Dates, Times and Type

From: [SDGE EOC Regulatory Notifications](#)
To: [CPUC PSPS Notifications](#)
Cc: [Raagas, Kirstie](#); [Skopec, Dan](#); [Faber, Clay](#); [Sidhar, Shivani N](#); [Blattner, William](#); [Kloberdanz, Kari](#); [Emergency Operations](#); [SDGE EOC Regulatory Notifications](#); [Beaver, Elizabeth](#)
Subject: RE: SDG&E PSPS Outages Restored: Santa Ana Wind Event/Red Flag Warning for October 26–27
Date: Tuesday, October 27, 2020 17:24:29
Attachments: [SDG&E PSPS Details CPUC 10-27-2020 1721.xlsx](#)

Good evening,

SDG&E has fully restored service to all customers impacted by this PSPS event as of 17:19. Please see attached spreadsheet for details of outages and restorations.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Sent: Tuesday, October 27, 2020 17:05
To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>
Cc: Raagas, Kirstie <KRaagas@sdge.com>; Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Kloberdanz, Kari <KKloberdanz@semprautilities.com>; Emergency Operations <EmergencyOperations@semprautilities.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Subject: RE: SDG&E PSPS Outages Restored: Santa Ana Wind Event/Red Flag Warning for October 26–27

Apologies for the error, but please see attached for corrected spreadsheet, reflecting 4 customer accounts (no MBL) that remain impacted by PSPS in the community of Boulevard. We continue efforts to restore service to these customers and will provide an update as soon as re-energization is complete.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications
Sent: Tuesday, October 27, 2020 16:42
To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>
Cc: Raagas, Kirstie <KRaagas@sdge.com>; Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Kloberdanz, Kari <KKloberdanz@semprautilities.com>; Emergency Operations <EmergencyOperations@semprautilities.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>
Subject: RE: SDG&E PSPS Outages Restored: Santa Ana Wind Event/Red Flag Warning for October 26–27

Good afternoon,

SDG&E completed the patrol process for all circuit devices impacted by this PSPS event and has restored service to all impacted customer accounts as of 16:30. Please see attached spreadsheet for details of outages and restorations. SDG&E's EOC will remain active through 18:00, when the Red Flag Warning in Orange County expires.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Sent: Tuesday, October 27, 2020 12:57
To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>
Cc: Raagas, Kirstie <KRagas@sdge.com>; Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Kloberdanz, Kari <KKloberdanz@semprautilities.com>; Emergency Operations <EmergencyOperations@semprautilities.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>
Subject: RE: SDG&E PSPS Initiated: Santa Ana Wind Event/Red Flag Warning for October 26–27

Please see below for correction to patrol start time below:

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Sent: Tuesday, October 27, 2020 12:55
To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>
Cc: Raagas, Kirstie <KRagas@sdge.com>; Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Kloberdanz, Kari <KKloberdanz@semprautilities.com>; Emergency Operations <EmergencyOperations@semprautilities.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>
Subject: RE: SDG&E PSPS Initiated: Santa Ana Wind Event/Red Flag Warning for October 26–27

Hello,

As of **12:50**, SDG&E has started the patrol process to restore service to the customers currently impacted by PSPS. Please At this time, there are no changes to the outage details reported at 11:02. Please note, estimated restoration times are subject to change based on field patrol observations and weather conditions.

Realtime outage updates are available at SDGE.com.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Sent: Tuesday, October 27, 2020 11:02
To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>
Cc: Raagas, Kirstie <KRagas@sdge.com>; Skopec, Dan <DSkopec@sdge.com>; SDGE EOC Regulatory

Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Kloberdanz, Kari <KKloberdanz@semprautilities.com>; Emergency Operations <EmergencyOperations@semprautilities.com>

Subject: RE: SDG&E PSPS Initiated: Santa Ana Wind Event/Red Flag Warning for October 26–27

Hello,

SDG&E has implemented additional PSPS in San Diego County due to high winds and increased fire risk conditions. Please see attached spreadsheet for outage details as of 1100. At this time, PSPS are impacting 1,466 customer accounts, including 105 MBL, in the communities of Boulevard and Jacumba.

Additional information, including maps with PSPS boundaries, is available at SDGE.com.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>

Sent: Tuesday, October 27, 2020 10:04

To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>

Cc: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>; Raagas, Kirstie <KRagas@sdge.com>; Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Kloberdanz, Kari <KKloberdanz@semprautilities.com>; Emergency Operations <EmergencyOperations@semprautilities.com>

Subject: RE: SDG&E PSPS Initiated: Santa Ana Wind Event/Red Flag Warning for October 26–27

Good morning,

SDG&E has implemented additional PSPS in areas of San Diego County due to high winds and increased fire risk conditions. Please see attached spreadsheet for outage details as of 1000. At this time, PSPS are impacting 1,043 customer accounts, including 67 MBL customers, in the community of Boulevard.

Additional information, including maps with PSPS boundaries, is available at SDGE.com.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>

Sent: Monday, October 26, 2020 17:14

To: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; 'CPUC PSPS Notifications' <PSPSNotification@cpuc.ca.gov>

Cc: Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Kloberdanz,

Kari <KKloberdanz@semprautilities.com>; Raagas, Kirstie <KRagas@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>; Emergency Operations <EmergencyOperations@semprautilities.com>; Weizman, Danielle <DWeizman@sdge.com>

Subject: SDG&E PSPS Re-Energization Completed: Santa Ana Wind Event/Red Flag Warning for October 26–27

SDG&E has restored service to all customers that were impacted by today's PSPS as of 4:51 p.m. Please see the attached spreadsheet for detailed information on all PSPS outages and customer impacts associated with this event.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>

Sent: Monday, October 26, 2020 1:43 PM

To: 'CPUC PSPS Notifications' <PSPSNotification@cpuc.ca.gov>

Cc: Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Kloberdanz, Kari <KKloberdanz@semprautilities.com>; Raagas, Kirstie <KRagas@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>; Emergency Operations <EmergencyOperations@semprautilities.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>

Subject: SDG&E PSPS Re-Energization Process Initiated: Santa Ana Wind Event/Red Flag Warning for October 26–27

SDG&E has started the re-energization process for customers impacted by this PSPS event.

Re-energization efforts are underway for the 5 circuits/devices, impacting 2,908 customer accounts, including 106 MBL. Please note, estimated restoration times are subject to change based on field patrol observations and weather conditions.

Realtime outage updates are available at SDGE.com.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>

Sent: Monday, October 26, 2020 11:06 AM

To: 'CPUC PSPS Notifications' <PSPSNotification@cpuc.ca.gov>

Cc: Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Kloberdanz, Kari <KKloberdanz@semprautilities.com>; Raagas, Kirstie <KRagas@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>; Emergency Operations <EmergencyOperations@semprautilities.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>

Subject: RE: SDG&E PSPS Initiated: Santa Ana Wind Event/Red Flag Warning for October 26–27

Updated with correct attachment

SDG&E has implemented additional PSPS in areas of San Diego County due to Santa Ana conditions and a Red Flag Warning in effect in the region.

Please see the attached spreadsheet for PSPS outages as of 1050. At this time, SDG&E has implemented PSPS for 5 circuits/devices, impacting 2,908 customer accounts, including 106 MBL. Please note, estimated restoration times are subject to change based on field patrol observations and weather conditions.

Additional information, including maps with PSPS boundaries, is available at SDGE.com.

Thank you,
SDG&E Regulatory Affairs

From: Raagas, Kirstie
Sent: Monday, October 26, 2020 9:47 AM
To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>
Cc: Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Beaver, Elizabeth <EBeaver@sdge.com>; Emergency Operations <EmergencyOperations@semprautilities.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Subject: SDG&E PSPS Initiated: Santa Ana Wind Event/Red Flag Warning for October 26–27

SDG&E has initiated Public Safety Power Shutoffs (PSPS) in areas of San Diego County due to Santa Ana conditions and a Red Flag Warning in effect in the region.

Please see the attached spreadsheet on PSPS outages as of 0940. At this time, SDG&E has implemented PSPS for 45 circuits/devices, impacting 2,743 customer accounts, including 96 MBL. Please note, estimated restoration times are subject to change based on field patrol observations and weather conditions.

Additional information, including maps with PSPS boundaries, is available at SDGE.com.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Sent: Monday, October 26, 2020 1:18 AM
To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>
Cc: Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Raagas, Kirstie <KRagas@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; Emergency Operations

<EmergencyOperations@semprautilities.com>

Subject: SDG&E Emergency Operations Center Activated: Santa Ana Wind Event/Red Flag Warning for October 26–27

Please see correction to EOC activation date below. Thank you.

Good morning,

SDG&E has activated its Emergency Operations Center (EOC) as of midnight today, Monday ~~September~~ October 26 due to Santa Ana conditions and a Red Flag Warning in effect in the region, which could necessitate Public Safety Power Shutoffs (PSPS).

There are no changes to the potential customer impacts since yesterday's update. Currently, there are no active PSPS in SDG&E's service area.

If you have any questions, please respond directly to this email; this inbox will be monitored throughout the duration of the event.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>

Sent: Monday, October 26, 2020 12:18 AM

To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>

Cc: Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Sidhar, Shivani N <SSidhar1@semprautilities.com>; Blattner, William <WBlattner@semprautilities.com>; Raagas, Kirstie <KRagas@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; Emergency Operations <EmergencyOperations@semprautilities.com>

Subject: SDG&E Emergency Operations Center Activated: Santa Ana Wind Event/Red Flag Warning for October 26–27

Good morning,

SDG&E has activated its Emergency Operations Center (EOC) as of midnight today, Monday September 26 due to Santa Ana conditions and a Red Flag Warning in effect in the region, which could necessitate Public Safety Power Shutoffs (PSPS).

There are no changes to the potential customer impacts since yesterday's update. Currently, there are no active PSPS in SDG&E's service area.

If you have any questions, please respond directly to this email; this inbox will be monitored throughout the duration of the event.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Sent: Sunday, October 25, 2020 11:25 AM
To: CPUC PSPS Notifications <PSPSNotification@cpuc.ca.gov>
Cc: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>; Raagas, Kirstie <KRagas@sdge.com>; Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Blattner, William <WBlattner@semprautilities.com>; Emergency Operations <EmergencyOperations@semprautilities.com>
Subject: RE: SDG&E PPS Protocols Initiated: Santa Ana Wind Event/Red Flag Warning Expected for October 26–27

Hello,

Weather forecasts for high fire risk conditions and strong winds in portions of SDG&E's service area remain consistent with yesterday's projections. Winds are still expected to begin in the early morning on Monday, October 26 and continue through the evening on Tuesday, October 27. SDG&E plans to activate its EOC at 12:00 a.m., midnight, on Monday, October 26, and remain staffed through the conclusion of the event.

NWS upgraded the Fire Weather Watch to a Red Flag Warning (RFW) for San Bernardino and Riverside County Mountains, Inland Empire, San Gorgonio Pass, and Inland Orange County. The RFW will be in effect from 2 a.m. Monday, October 26, through 6 p.m. Tuesday, October 27. The High Wind Warning remains in effect for the same areas from 2 a.m. Monday, October 26, through 2 p.m. Tuesday, October 27. The Fire Potential Index (FPI) on Monday is forecast to be "Extreme" in Orange County; the FPI is expected to return to below extreme levels on Tuesday.

Yesterday, SDG&E made advanced notification to customers associated with 21,481 accounts, including 712 MBL customers, potentially in scope for this event. SDG&E will continue to provide notifications and updates customers that may be impacted by this event. Based on current weather forecasts, there are no changes to the potential scope for this event, which includes the following communities:

- Camp Pendleton
- San Clemente
- San Juan Capistrano (east)
- Fallbrook
- Oceanside

Additional information related to this event, including maps with PPS boundaries, will be posted to SDGE.com.

Unless there are changes requiring immediate notification, we will provide another update tomorrow, October 26, when SDG&E's EOC is activated.

Thank you,

SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Sent: Saturday, October 24, 2020 12:57
To: CPUC PPS Notifications <PSPSNotification@cpuc.ca.gov>
Cc: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>; Beaver, Elizabeth <EBeaver@sdge.com>; Raagas, Kirstie <KRagas@sdge.com>; Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Blattner, William <WBlattner@semprautilities.com>; Emergency Operations <EmergencyOperations@semprautilities.com>
Subject: RE: SDG&E PPS Protocols Initiated: Santa Ana Wind Event/Red Flag Warning Expected for October 26–27

Good afternoon,

Weather forecasts for Santa Ana wind conditions remain in place for portions of SDG&E's service area. At this time, winds are expected to start increasing in strength in the early morning on Monday, October 26 and continuing through the evening on Tuesday, October 27.

The National Weather Service (NWS) has issued a Fire Weather Watch for Monday at 2 a.m. through Tuesday at 6 p.m., as well as a High Wind Watch for Monday at 2 a.m. through Tuesday at 5 p.m. for the Inland Empire, inland Orange County, San Bernardino County mountains, and Santa Ana Mountains.

SDG&E will activate its EOC at 12:00 a.m. on Monday, October 26 and remain staffed through the conclusion of the event.

At this time, SDG&E plans to provide advanced notification today, October 24, to customers associated with 21,481 accounts, including 712 Medical Baseline (MBL) customers, that could potentially be impacted by this event. Notifications will be made to customers in the following communities:

- Camp Pendleton
- San Clemente
- San Juan Capistrano (east)
- Fallbrook
- Oceanside

There are no active de-energizations at this time. Additional information, including maps with PPS boundaries, will be posted to SDGE.com.

Unless there are changes requiring immediate notification, we will provide another update tomorrow, Sunday, October 25.

Thank you,
SDG&E Regulatory Affairs

From: SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Sent: Friday, October 23, 2020 12:26

To: Caroline Thomas Jacobs <Caroline.ThomasJacobs@cpuc.ca.gov>; 'Dan Bout (CPUC)' <daniel.bout@cpuc.ca.gov>; 'Devla Singh (CPUC)' <devla.singh@cpuc.ca.gov>; 'Leslie "Lee" Palmer (CPUC)' <Leslie.Palmer@cpuc.ca.gov>; 'Nika Kjensli (CPUC)' <nika.kjensli@cpuc.ca.gov>; Rachel Peterson <rachel.peterson@cpuc.ca.gov>; 'Tony Noll (CPUC)' <Anthony.Noll@cpuc.ca.gov>
Cc: Beaver, Elizabeth <EBeaver@sdge.com>; Raagas, Kirstie <KRagas@sdge.com>; Skopec, Dan <DSkopec@sdge.com>; Faber, Clay <CFaber@sdge.com>; Blattner, William <WBlattner@semprautilities.com>; Emergency Operations <EmergencyOperations@semprautilities.com>; SDGE EOC Regulatory Notifications <SDGEEOCRegulatoryNotifications@sdge.com>
Subject: SDG&E PSPS Protocols Initiated: Santa Ana Wind Event/Red Flag Warning Expected for October 26–27

Good afternoon,

SDG&E has initiated its Public Safety Power Shutoff (PSPS) protocols based on weather forecasts for Santa Ana wind conditions expected to impact areas of Orange County and northeast San Diego starting in the evening on Monday, October 26, 2020. SDG&E has not activated its Emergency Operations Center (EOC) at this time. SDG&E's EOC staff will remain in a monitoring and planning mode until further notice.

Preliminary weather forecasts and PSPS impacts

- Santa Ana winds are expected to begin in portions of SDG&E's service area on Monday, October 26. Winds are expected to peak in the morning on Tuesday, Oct. 27, and gradually decrease through the day on Tuesday.
- Based on preliminary forecasts, PSPS impacts are possible for approximately 19,651 customer accounts, including 650 Medical Baseline (MBL) customers, in the following communities:
 - San Clemente
 - Bonsall
 - Oceanside
 - Fallbrook
 - Camp Pendleton
 - De Luz
 - Rainbow
 - Ortega Highway
 - San Clemente
- Initial notice will be provided to public safety partners today; initial customer notifications will be made tomorrow, Saturday, October 24.

Unless there are changes requiring immediate notification, we will provide another update tomorrow, Saturday, October 24.

Thank you,
SDG&E Regulatory Affairs

Appendix 4
Government Notifications: Dates, Times and Type

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

The below table includes email notifications sent to the staff of the following representatives and officials by Mitch Mitchell—SDG&E Vice President, State Governmental Affairs & External Affairs and Kent Kauss—SDG&E Vice President, External Relations:

Senators: Atkins, Hueso, Jones, Melendez, Bates, Moorlach; the Senate Republicans Office; the Legislative Analysts’ Office; Assemblymembers: Brough, Gloria, Gonzalez, Voepel, Waldron, Rendon, Holden, Boerner Horvath, Gloria, Maienschein, Weber; the State Assembly Republican Caucus; the California Natural Resources Agency; Office of the Governor, and the CPUC.

Date/ Time	Message
10/26/2020 8:29 p.m.	<p>SDG&E’s current forecast includes moderate to locally strong winds from the north/northeast in Orange County and northwest San Diego County overnight Sunday through Monday, with fire weather watch for Inland Orange County in effect for Monday. We anticipate that if public safety power shutoffs are required, the estimated start time of the event would be early Monday morning. We anticipate that under these conditions, the event could last through Tuesday evening.</p> <p>To protect fire-prone communities in parts of the service territory, SDG&E may activate its Emergency Operations Center to monitor adverse weather conditions throughout the duration of this event. These conditions may require us to initiate public safety power shutoffs within the next 24-48 hours to very localized areas of the territory as a measure of last resort to reduce fire risk; the following communities may be impacted:</p> <ul style="list-style-type: none"> • Camp Pendleton • East San Juan Capistrano • Fallbrook • Oceanside • San Clemente <p>We estimate approximately 21,481 customers may be impacted, including 712 Medical Baseline (MBL) customers in the potentially impacted communities.</p> <p>We will keep you posted as the weather system approaches.</p>
10/26/2020 2:10 p.m.	<p>SDG&E has implemented a PSPS event impacting the Fallbrook community impacting 2,908 customers. Power may be out overnight and remain out for up to 72 hours.</p> <p>We continue to monitor the situation and could implement additional PSPS efforts impacting about 18k customers in the communities of Camp Pendleton, E San Juan Capistrano, Oceanside, Pala Reservation and San Clemente.</p>
10/26/2020 4:51 p.m.	<p>Weather conditions have improved, and SDG&E crews have begun inspecting power lines to make sure they are safe to operate and determining when power can be turned back on to affected communities. We understand there is no good time to be without power, and we appreciate your patience as we work as</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Date/ Time	Message
	<p>quickly and safely as possible. We do not expect to restore all customers this evening. For up-to-date information on outages and when power may be turned back on, please visit www.sdge.com/outages, check our mobile app, or follow us on Twitter. Additional languages: www.SDGE.com/m13e.</p> <p>Currently, we have 2,908 customers out of service in the Fallbrook area, including 106 medical baseline customers. The following Community Resource Center will be open until 10 p.m. Please note all Community Resource Centers are drive-thru for health reasons:</p> <p>Fallbrook County Library 124 S. Mission Road Fallbrook, CA 92028</p>
10/26/2020 10:27 p.m.	We were able to complete inspections and all customers were restored a couple hours ago
10/27/2020 12:09 p.m.	<p>Due to high fire risk weather conditions affecting power lines serving your community, power has been shut off to reduce the risk of wildfire. Power may be out overnight and remain out for up to 72 hours.</p> <p>Communities Impacted:</p> <ul style="list-style-type: none"> • Boulevard • Manzanita Reservation • La Posta Reservation • Campo Reservation
10/27/2020 1:39 p.m.	<p>Weather conditions have improved, and SDG&E crews have begun inspecting power lines to make sure they are safe to operate and determining when power can be turned back on to affected communities.</p> <p>Currently, we have 1,466 customers out of service in the Fallbrook area, including 116 medical baseline customers</p>
10/27/2020 5:43 p.m.	We have restored power to those impacted by the PSPS event.

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

The below table includes notifications sent via text message directly to the following representatives and officials by Mitch Mitchell—SDG&E Vice President, State Governmental Affairs & External Affairs and Kent Kauss—SDG&E Vice President, External Relations:

Senators Bates, Moorlach, Jones, Melendez, Atkins, Hueso; Assemblymembers Voepel, Waldron, Brough, Maienschein, Gloria, Gonzalez, Weber, Boerner Horvath

Date/ Time	Message
10/24/2020 3:28 p.m.	<p>We continue to monitor an approaching weather system and Santa Ana wind conditions. Based on current forecasts we anticipate that if public safety power shutoffs are required, the estimated start time of the event would be early Monday morning. We anticipate that under these conditions, the event could last through the day, with full restoration estimated Monday evening.</p> <p>Impacted communities may include: Boulevard Campo Campo Reservation Descanso Jamul La Posta Reservation Manzanita Reservation Santa Ysabel Santa Ysabel Reservation</p> <p>We will keep you and your staff updated</p> <p>Kent and Mitch</p>
10/24/2020 3:36 p.m.	<p>We estimate 700 customers including 34 Medical Baseline Customers could be impacted. A map is included here showing the potential area impacted - it's not the best picture but provides a look that is text friendly.</p>
10/24/2020 8:36 p.m.	<p>We have a weather system approaching the service territory which could result in PSPS being triggered. We have sent your staff greater detail but we are looking at the following areas: Camp Pendleton East San Juan Capistrano Fallbrook Oceanside San Clemente.</p> <p>Estimated impact is about 21,000 customers including 712 medical baseline customers.</p> <p>Looking at Sunday evening and Monday. More to follow as we continue to monitor.</p> <p>Any questions let me or Mitch know.</p>

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Date/ Time	Message
10/26/2020 2:13 p.m.	We have de-energized 2,908 customers in the Fallbrook area and are still monitoring the situation in the following areas: Camp Pendleton, East San Juan Capistrano, Oceanside, Pala Reservation and San Clemente. We have opened a Community Resource Center at the Fallbrook Branch Library on S Mission Road.
10/26/2020 4:59 p.m.	Weather is improving in our region. Our crews have started their inspection work but are limited with daylight so not known yet how many will be restored tonight. Our Community Resource Center will remain open until 10pm for phone charging, water, snacks, info etc.
10/27/2020 12:43 p.m.	Weather conditions continue to be challenging and we have de-energized the communities of Boulevard, Manzanita Reservation, La Posta Reservation, Campa Reservation and Jacumba. A total of 1,466 customers are impacted
10/27/2020 1:41 p.m.	Weather conditions have improved, and our crews are doing their inspection work to enable us to restore service. 1,466 customers including 116 medical baseline customers are currently impacted.
10/27/2020 5:44 p.m.	Power has been restored. Inspection complete and we were able to safely restore power.

Appendix 5

CalOES Notifications: Confirmation of Online Portal Notifications

SDG&E Report on Public Safety Power Shutoff Event: October 26–27, 2020

Confirmation of SDG&E notifications provided through CalOES online notification portal

