



THIS IS A SAMPLE OF THE PLAQUE OR DIRECTORY REQUIRED WHEN THERE IS AN ALTERNATE SOURCE OF POWER CONNECTED TO THE PREMISES WIRING SYSTEM. SPECIFY THE TYPE OF GENERATION, SUCH AS STATIONARY ENGINE GENERATION, PV ARRAY, BATTERIES, MICRO TURBINE, FUEL CELL, ETC.

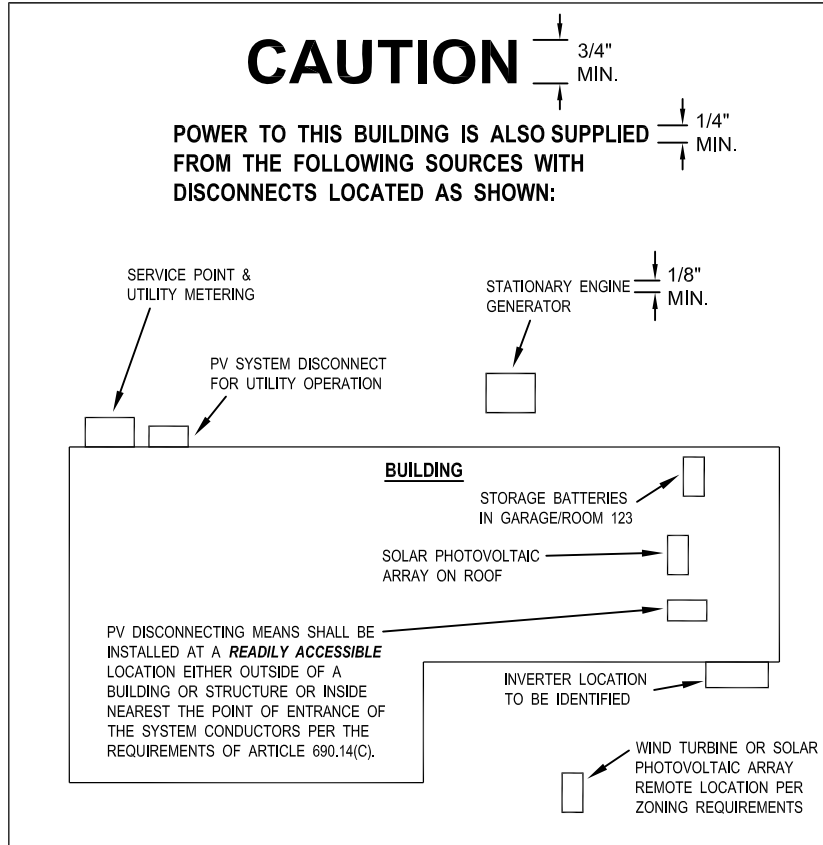

The plaque shall be metal or plastic, with engraved or machine printed letters in a contrasting color to the plaque, shall include the location of the service point, utility meter, AC and DC disconnects, inverter, PV Array, Generator or other types of generation sources, and a footprint of the entire building and site. The plaque shall be attached to the exterior of the enclosure for the service disconnect with pop-rivets, machine screws, or other fasteners acceptable to the AHJ. Attachment methods must be made watertight and the integrity of the enclosure rating must be maintained. Epoxy or other adhesive is no longer an acceptable method of securing.

PLAQUE FOR UTILITY AC DISCONNECT

THIS IS A SAMPLE OF THE PLAQUE TO BE INSTALLED ON THE FACE OF THE UTILITY AC DISCONNECT. IF MULTIPLE UTILITY DISCONNECTS ARE INSTALLED, EACH DISCONNECT SHALL HAVE ITS OWN PLAQUE ATTACHED.

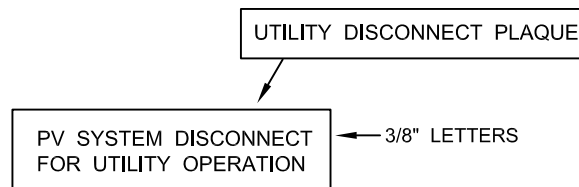

PLAQUE SPECIFICATIONS

THE PLAQUE SHALL BE METAL OR PLASTIC, WITH ENGRAVED OR MACHINE PRINTED LETTERS, OR ELECTRO-PHOTO PLATING, IN A CONTRASTING COLOR TO THE PLAQUE. PLAQUE SHALL BE ATTACHED TO THE "UTILITY AC DISCONNECT" WITH POP-RIVETS, SCREWS.