


**PLAQUE REQUIREMENTS**

The plaque shall be plastic with engraved or machine printed letters in contrasting color to the plaque, and shall be permanently attached to the fuse box with pop rivets or screws. The typical plaque configuration is shown below.

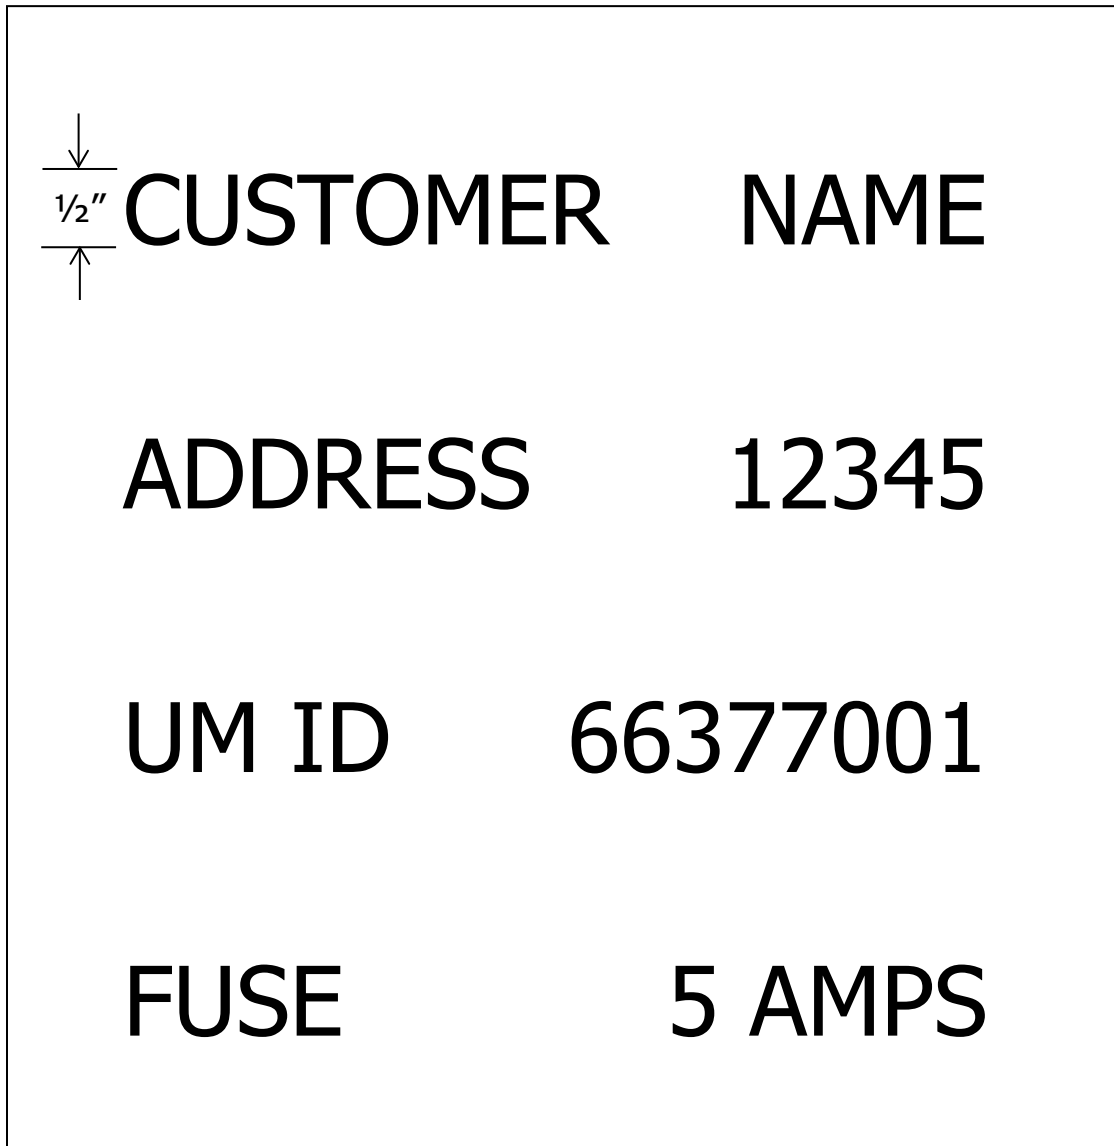

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 5 OF 10	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 524.5
	SDG&E SERVICE STANDARDS & GUIDE				
	<b>UNMETERED ELECTRIC SERVICE</b>				